

Maintenance-free

EK90 smoke control dampers
meet all requirements in accordance with European
standards and are universal for all applications.

Further uses and extended fire classification

EI 90 (v_{edw} - h_{odw} - $i \leftrightarrow o$) S1500 C_{mod} HOT400/30 MA multi

EK90 smoke control dampers

Application examples for smoke extraction and for ventilation, as required, in the form of "combi-dampers"



- | | | | |
|----------|--|----------|--|
| A | Closed smoke control damper | 1 | Smoke control damper in an air intake |
| B | Opened smoke control damper | 2 | Smoke control damper suspended underneath ceilings |
| C | Ventilator for smoke extraction and also for ventilation | 3 | Smoke control damper in a shaft wall |
| D | Smoke extraction duct with fire resistance period | 4 | Smoke control damper in a vertical smoke extraction duct |
| E | Smoke extraction duct without fire resistance period | 5 | Smoke control damper in a horizontal smoke extraction duct |

EK90 smoke control dampers

Description, properties, sizes


Maintenance-free

EK90 smoke control dampers EN 12101-8 – Series EK92 –

With casing and damper blades made from abrasion-proof, safe, corrosion-resistant calcium silicate that is suitable for higher temperatures. The edge protection profiles are made from galvanized steel and include connection holes.

Opening and closing is carried out by means of stainless steel shafts using electric motor drives for 24 V AC/DC or 230 V AC even when the fan is running and at inflow velocities of up to 20 m/s.

Special seals without any additional stops allow for large free cross-sections and thus extremely low pressure drops and sound power levels.

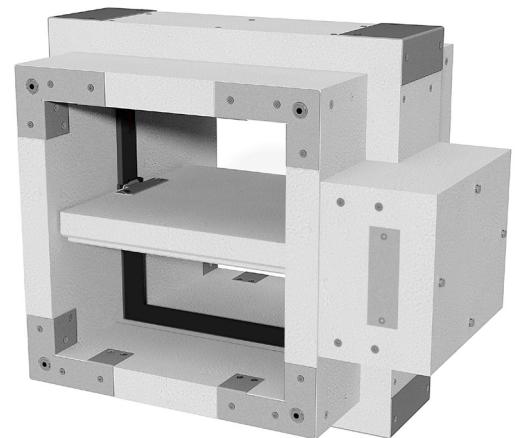

Declaration of performance DoP no. CPR/EK90/003

German approval Z 56.4212 – 1007

Environmental Product Declaration according to ISO 14025 and
EN 15804 EPD-WIL-20160047-ICC1-DE

Casing leak tightness class C according to EN 1751

Fire classification

EI 90 (v_{edw} - h_{odw} - i ↔ o) S1500 C_{mod} HOT400/30 MA multi

- **EI90** Fire resistance period of 90 minutes

Installation:

v_{e d} in and on horizontal smoke extraction ducts.

h_{o d} in and on vertical smoke extraction ducts.

v_{e w} in rigid walls and in flexible walls.

h_{o w} in rigid ceilings.

i ↔ o Fire exposure has been verified on both sides.

- **S1500** For smoke extraction systems with operating pressures between 1500 Pa negative pressure and 500 Pa overpressure (pressure class 3). Smokeproof at up to 1500 Pa differential pressure.

- **C_{mod}** For systems designed only for smoke extraction and also for combined ventilation systems that was as heating, ventilation and air conditioning systems. Intermediate damper blade positions for volume flow adjustment are permitted (modulation mode).

The service life is verified by 20,000 weight-loaded cycles.

- **HOT** The smoke control dampers close and open again at least after 30 minutes of fire exposure at 400°C.
- **MA** Closed smoke control dampers can be opened after 25 minutes of full exposure to fire (> 800°C).
- **multi** The smoke control dampers may be used between fire compartments (multi) and in individual areas (single).

Widths B: 200 mm to 1500 mm

Heights H:: 200 mm to 800 mm

Lengths L: 350 mm to 850 mm

All dimensions are available in 5-mm increments!

Installation with horizontal or vertical damper blade:

- in rigid walls and ceilings, ≥ 100 mm thick and ≥ 450 kg/m³ bulk density. Wet installation with mortar or a dry installation with mineral wool ≥ 100 kg/m³ are possible.
- in metal stud walls, ≥ 95 mm thick, with or without mineral wool ≤ 100 kg/m³ inside.
- on and between horizontal or vertical smoke extraction ducts.


Can be connected:

- in single or double-sided arrangement on smoke extraction ducts with fire resistance period,
- in single-sided arrangement on smoke extraction ducts without fire resistance period,
- in single or double-sided arrangement on protective grille

⇒ see also page 34

EK90 smoke control dampers

Data sheet

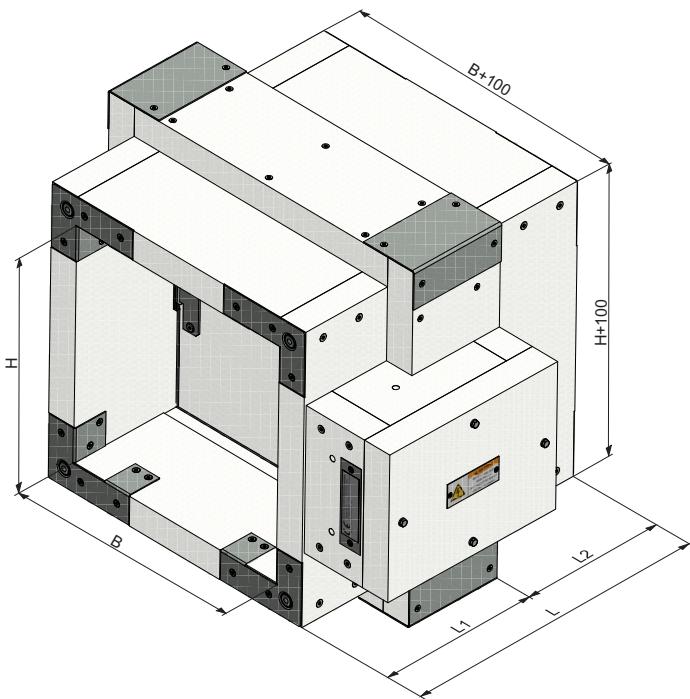

Calculating damper blade excess lengths:


- $\ddot{U}1 = \frac{1}{2} \cdot H - L1 + 105 \text{ mm}; \ddot{U}2 = \frac{1}{2} \cdot H - L2 - 107 \text{ mm}$
- If $\ddot{U}1 \leq 0$ or $\ddot{U}2 \leq 0$, there is no damper blade excess length!

If protective grilles are mounted directly on the casings, then $\ddot{U}1$ or $\ddot{U}2$ should be at least -20 mm, which equates to a 20-mm freedom of movement. Hence, $L1 \geq \frac{1}{2} \cdot H + 125 \text{ mm}$ and $L2 \geq \frac{1}{2} \cdot H - 87 \text{ mm}$ should be applied!

$L2 \geq W(D) + Z$ is also necessary! Here, **W** = thickness of the wall, **D** = thickness of the ceiling. **Z** is the necessary casing excess length.

Examples:

- Fitting of shear protection brackets A.⇒ see page 19
- Connection of smoke extraction ducts.⇒ see page 23

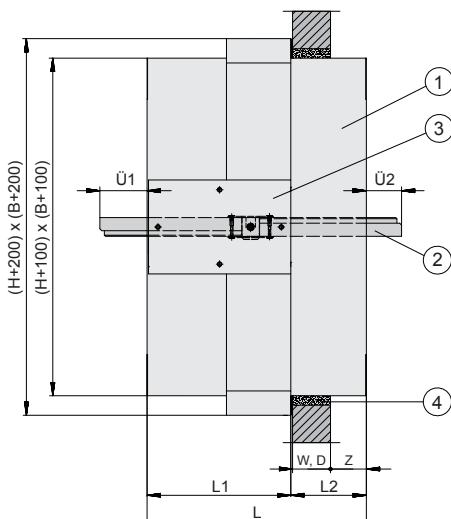

1 Casing

2 Damper blade

3 Protective casing with opening for motor drive cover

Standard widths B [mm]

200 - 225 - 250 - 275 - 300 - 325 - 350 - 375 - 400 - 450

500 - 550 - 600 - 650 - 700 - 750 - 800 - 850 - 900 - 950

1000 - 1050 - 1100 - 1150 - 1200 - 1250 - 1300 - 1400 - 1500

Standard heights H [mm]

200 - 225 - 250 - 275 - 300 - 325 - 350 - 375 - 400 - 450

500 - 550 - 600 - 650 - 700 - 750 - 800

Standard lengths [mm]

| for heights H | Length L | Length L1 | Length L2 |
|---------------------|----------|-----------|-----------|
| up to 450 mm: | 500 mm | 330 mm | 170 mm |
| larger than 450 mm: | 550 mm | 380 mm | 170 mm |

Smallest lengths for lateral mounting on smoke extraction ducts

| for heights H | Length L | Length L1 | Length L2 |
|---------------------|----------|-----------|-----------|
| up to 450 mm: | 350 mm | 330 mm | 20 mm |
| larger than 450 mm: | 400 mm | 380 mm | 20 mm |

Standard lengths of special electrical connection design

| for all heights H | Length L | Length L1 | Length L2 |
|-------------------|----------|-----------|-----------|
| 200 to 800 mm: | 550 mm | 380 mm | 170 mm |


Smallest lengths for lateral mounting on smoke extraction ducts

| for all heights H | Length L | Length L1 | Length L2 |
|-------------------|----------|-----------|-----------|
| 200 to 800 mm | 400 mm | 380 mm | 20 mm |

Intermediate dimensions for B, H, L, L1 and L2 are available in 5 mm increments. L is always = L1 + L2.

Lengths for double-sided mounting of protective grilles

⇒ see page 34

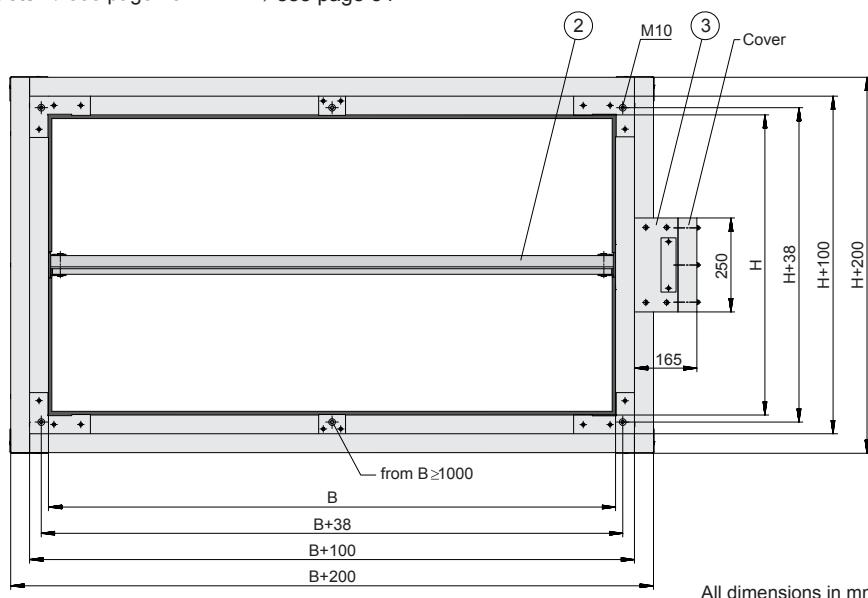

All dimensions in mm

4 Installation gap filled with mortar or mineral wool $\geq 100 \text{ kg/m}^3$

W: Wall thickness / D: Ceiling thickness / Z: Casing excess length

EK90 smoke control dampers

Pressure drop coefficients ζ / nomenclature

| H | B = 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|---------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | 1.118 | 1.071 | 1.035 | 1.006 | 0.983 | 0.964 | 0.948 | 0.934 | 0.922 | 0.902 | 0.887 | 0.875 | 0.864 | 0.856 | 0.849 |
| 225 | 0.908 | 0.868 | 0.837 | 0.812 | 0.792 | 0.775 | 0.761 | 0.749 | 0.739 | 0.722 | 0.709 | 0.698 | 0.689 | 0.682 | 0.676 |
| 250 | 0.768 | 0.732 | 0.704 | 0.682 | 0.664 | 0.649 | 0.637 | 0.626 | 0.617 | 0.602 | 0.590 | 0.581 | 0.573 | 0.566 | 0.561 |
| 275 | 0.669 | 0.636 | 0.610 | 0.590 | 0.574 | 0.560 | 0.549 | 0.539 | 0.531 | 0.517 | 0.506 | 0.497 | 0.490 | 0.484 | 0.479 |
| 300 | 0.595 | 0.564 | 0.540 | 0.521 | 0.506 | 0.494 | 0.483 | 0.474 | 0.466 | 0.453 | 0.443 | 0.435 | 0.429 | 0.423 | 0.418 |
| 325 | 0.537 | 0.508 | 0.486 | 0.469 | 0.454 | 0.442 | 0.432 | 0.424 | 0.417 | 0.405 | 0.395 | 0.388 | 0.381 | 0.376 | 0.372 |
| 350 | 0.492 | 0.464 | 0.443 | 0.427 | 0.413 | 0.402 | 0.392 | 0.384 | 0.377 | 0.366 | 0.357 | 0.350 | 0.344 | 0.339 | 0.335 |
| 375 | 0.455 | 0.429 | 0.409 | 0.393 | 0.380 | 0.369 | 0.360 | 0.352 | 0.345 | 0.335 | 0.326 | 0.319 | 0.314 | 0.309 | 0.305 |
| 400 | 0.425 | 0.399 | 0.380 | 0.365 | 0.352 | 0.342 | 0.333 | 0.326 | 0.319 | 0.309 | 0.300 | 0.294 | 0.288 | 0.284 | 0.280 |
| 450 | 0.377 | 0.354 | 0.335 | 0.321 | 0.309 | 0.299 | 0.291 | 0.284 | 0.278 | 0.269 | 0.261 | 0.255 | 0.250 | 0.245 | 0.242 |
| 500 | 0.342 | 0.320 | 0.302 | 0.289 | 0.277 | 0.268 | 0.260 | 0.254 | 0.248 | 0.239 | 0.231 | 0.226 | 0.221 | 0.217 | 0.213 |
| 550 | 0.315 | 0.294 | 0.277 | 0.264 | 0.253 | 0.244 | 0.237 | 0.230 | 0.225 | 0.216 | 0.209 | 0.203 | 0.199 | 0.195 | 0.191 |
| 600 | 0.294 | 0.273 | 0.257 | 0.244 | 0.234 | 0.225 | 0.218 | 0.212 | 0.207 | 0.198 | 0.191 | 0.186 | 0.181 | 0.177 | 0.174 |
| 650 | 0.277 | 0.256 | 0.240 | 0.228 | 0.218 | 0.210 | 0.203 | 0.197 | 0.192 | 0.183 | 0.177 | 0.171 | 0.167 | 0.163 | 0.160 |
| 700 | 0.262 | 0.242 | 0.227 | 0.215 | 0.205 | 0.197 | 0.190 | 0.184 | 0.179 | 0.171 | 0.165 | 0.160 | 0.155 | 0.152 | 0.149 |
| 750 | 0.250 | 0.231 | 0.216 | 0.204 | 0.194 | 0.186 | 0.180 | 0.174 | 0.169 | 0.161 | 0.155 | 0.150 | 0.145 | 0.142 | 0.139 |
| 800 | 0.240 | 0.221 | 0.206 | 0.194 | 0.185 | 0.177 | 0.171 | 0.165 | 0.160 | 0.152 | 0.146 | 0.141 | 0.137 | 0.134 | 0.131 |



| H | B = 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|---------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | 0.842 | 0.837 | 0.832 | 0.828 | 0.824 | 0.821 | 0.818 | 0.815 | 0.812 | 0.810 | 0.808 | 0.806 | 0.803 | 0.800 |
| 225 | 0.670 | 0.666 | 0.662 | 0.658 | 0.655 | 0.652 | 0.649 | 0.647 | 0.645 | 0.643 | 0.641 | 0.639 | 0.636 | 0.634 |
| 250 | 0.556 | 0.552 | 0.548 | 0.545 | 0.542 | 0.539 | 0.537 | 0.535 | 0.533 | 0.531 | 0.530 | 0.528 | 0.525 | 0.523 |
| 275 | 0.475 | 0.471 | 0.467 | 0.464 | 0.462 | 0.459 | 0.457 | 0.455 | 0.454 | 0.452 | 0.451 | 0.449 | 0.447 | 0.445 |
| 300 | 0.414 | 0.411 | 0.408 | 0.405 | 0.402 | 0.400 | 0.398 | 0.397 | 0.395 | 0.393 | 0.392 | 0.391 | 0.389 | 0.387 |
| 325 | 0.368 | 0.365 | 0.362 | 0.359 | 0.357 | 0.355 | 0.353 | 0.351 | 0.350 | 0.348 | 0.347 | 0.346 | 0.344 | 0.342 |
| 350 | 0.331 | 0.328 | 0.325 | 0.323 | 0.321 | 0.319 | 0.317 | 0.315 | 0.314 | 0.312 | 0.311 | 0.310 | 0.308 | 0.306 |
| 375 | 0.301 | 0.298 | 0.296 | 0.293 | 0.291 | 0.289 | 0.288 | 0.286 | 0.285 | 0.284 | 0.282 | 0.281 | 0.279 | 0.278 |
| 400 | 0.277 | 0.274 | 0.271 | 0.269 | 0.267 | 0.265 | 0.264 | 0.262 | 0.261 | 0.260 | 0.259 | 0.257 | 0.256 | 0.254 |
| 450 | 0.239 | 0.236 | 0.233 | 0.231 | 0.229 | 0.228 | 0.226 | 0.225 | 0.224 | 0.223 | 0.221 | 0.221 | 0.219 | 0.217 |
| 500 | 0.210 | 0.208 | 0.205 | 0.203 | 0.202 | 0.200 | 0.199 | 0.197 | 0.196 | 0.195 | 0.194 | 0.193 | 0.192 | 0.190 |
| 550 | 0.189 | 0.186 | 0.184 | 0.182 | 0.180 | 0.179 | 0.178 | 0.176 | 0.175 | 0.174 | 0.173 | 0.172 | 0.171 | 0.169 |
| 600 | 0.172 | 0.169 | 0.167 | 0.165 | 0.164 | 0.162 | 0.161 | 0.160 | 0.158 | 0.157 | 0.157 | 0.156 | 0.154 | 0.153 |
| 650 | 0.158 | 0.155 | 0.153 | 0.151 | 0.150 | 0.148 | 0.147 | 0.146 | 0.145 | 0.144 | 0.143 | 0.142 | 0.141 | 0.140 |
| 700 | 0.146 | 0.144 | 0.142 | 0.140 | 0.139 | 0.137 | 0.136 | 0.135 | 0.134 | 0.133 | 0.132 | 0.131 | 0.130 | 0.129 |
| 750 | 0.137 | 0.134 | 0.132 | 0.131 | 0.129 | 0.128 | 0.127 | 0.125 | 0.124 | 0.123 | 0.123 | 0.122 | 0.120 | 0.119 |
| 800 | 0.128 | 0.126 | 0.124 | 0.123 | 0.121 | 0.120 | 0.119 | 0.117 | 0.116 | 0.116 | 0.115 | 0.114 | 0.113 | 0.111 |

Nomenclature

| | | | |
|-----------------------------|--|-------------------|---|
| B [mm] | Clear width of the smoke control damper | ζ | Pressure drop coefficient |
| H [mm] | Clear height of the smoke control damper | Δp_s [Pa] | Pressure drop with smoke control damper fully open Δp_s [Pa] = $\frac{1}{2} \cdot 1.2 \text{ [kg/m}^3\text{]} \cdot \zeta \cdot v_A \text{ [m/s]}^2$ |
| A_A [m^2] | Inflow cross-section $A_A = B \text{ [m]} \cdot H \text{ [m]}$ | L_{WA} [dB(A)] | A-weighted sound power level (area-corrected) |
| A_{free} [m^2] | Free cross-section \Rightarrow see table on page 16 | L_{W-Oct} [dB] | Octave sound power level $L_{W-Oct} = L_{WA} + \Delta L$ |
| v_0 [m/s] | Flow velocity in A_{free} | ΔL [dB] | Relative sound power level |
| v_A [m/s] | Flow velocity in A_A Inflow velocity | f [Hz] | Octave mid frequency |
| V [m ³ /h] | Volume flow | | |

EK90 smoke control dampers

Volume flow V , pressure drop Δp , inflow velocity v_A


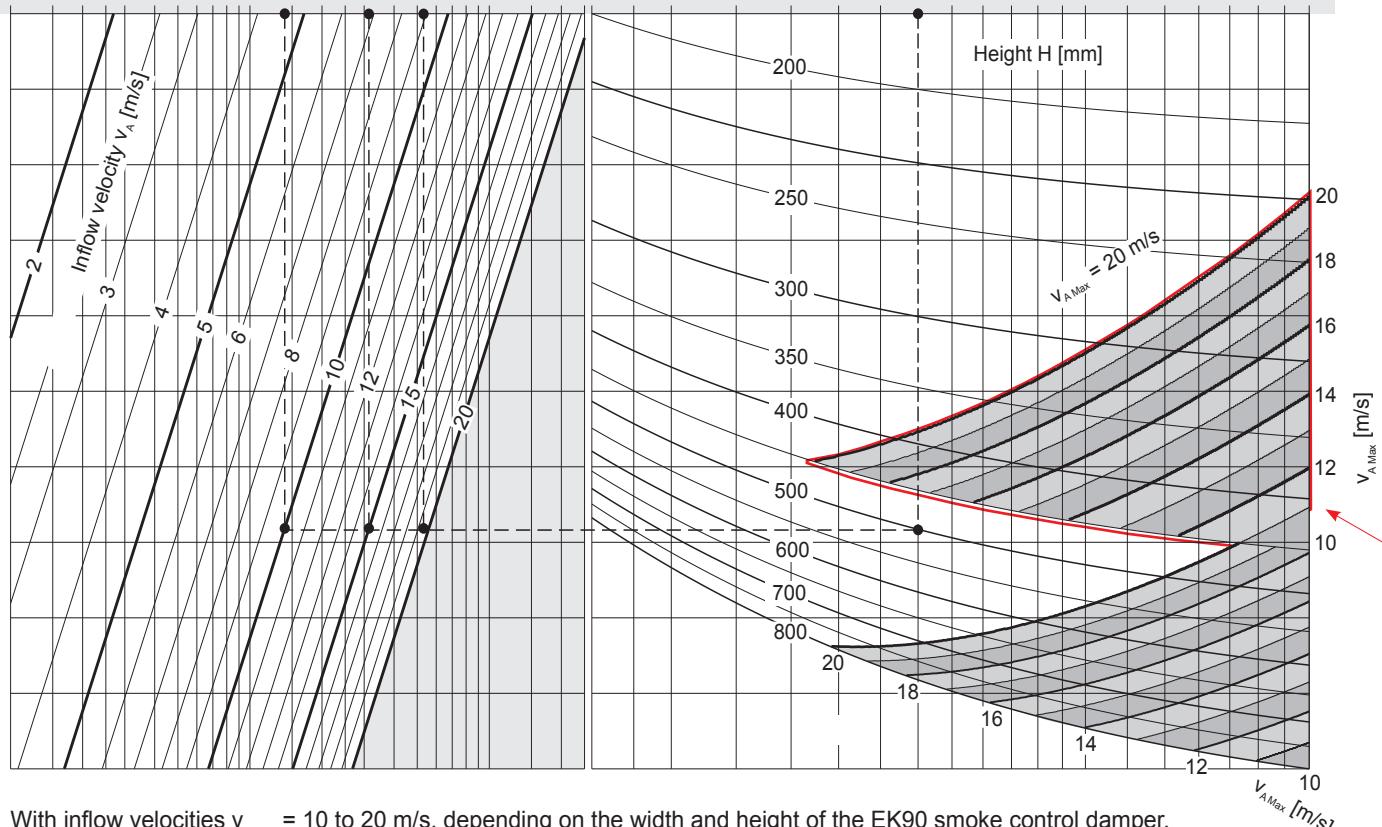
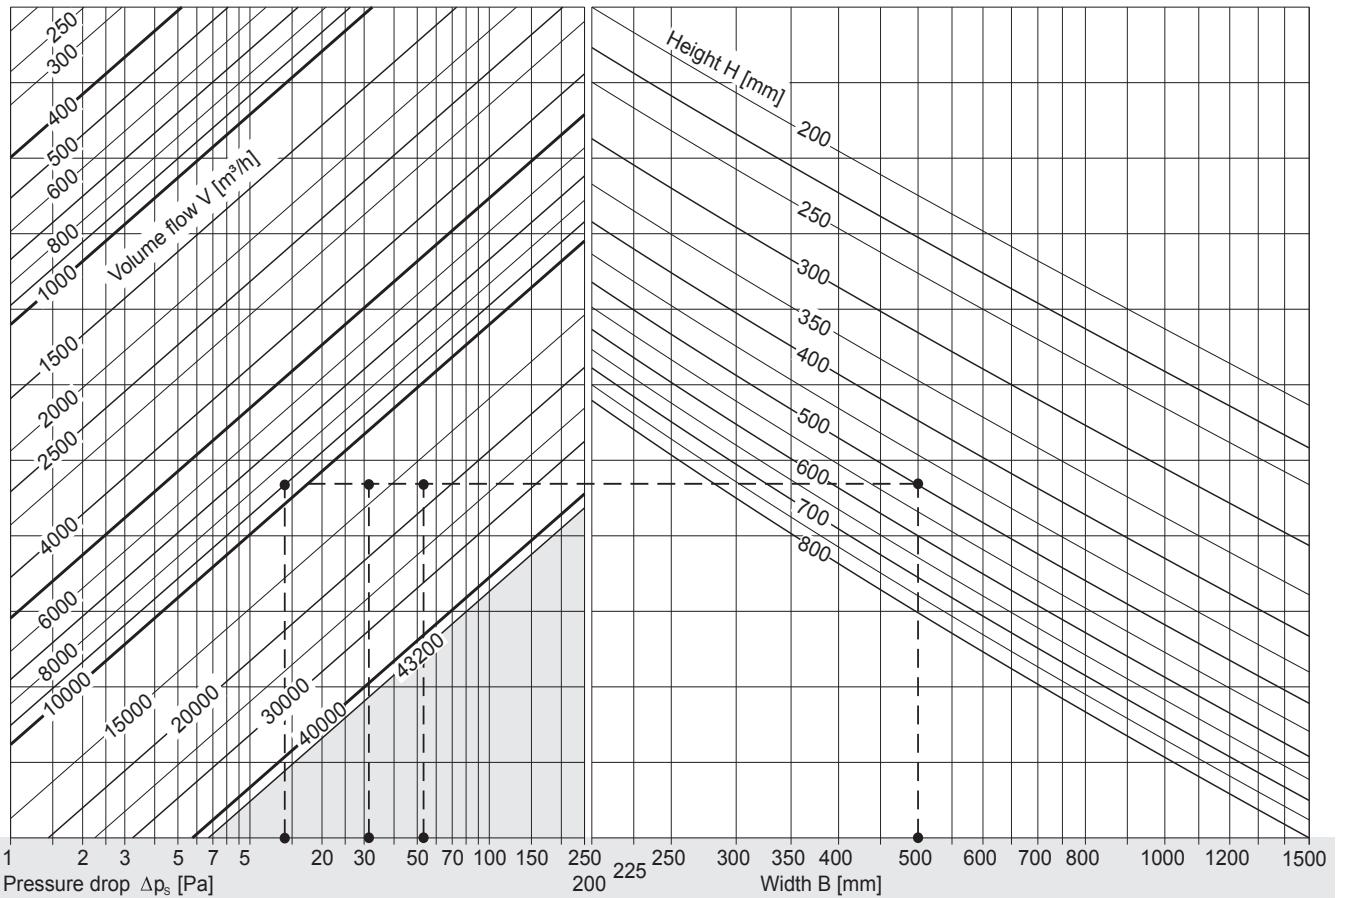


With inflow velocities $v_{A_{Max}} = 10$ to 20 m/s, depending on the width and height of the EK90 smoke control damper, the inflow velocity limits the opening of the smoke control damper. It may need to be reduced temporarily!

Example: The intersection point B = 500 mm with H = 500 mm lies in the field $a_{\text{Max}} = 20 \text{ m/s}$. There is no restriction here! \Rightarrow see also table on page 7!

EK90 smoke control dampers

Sound power level L_{WA} / examples / inflow velocities v_A

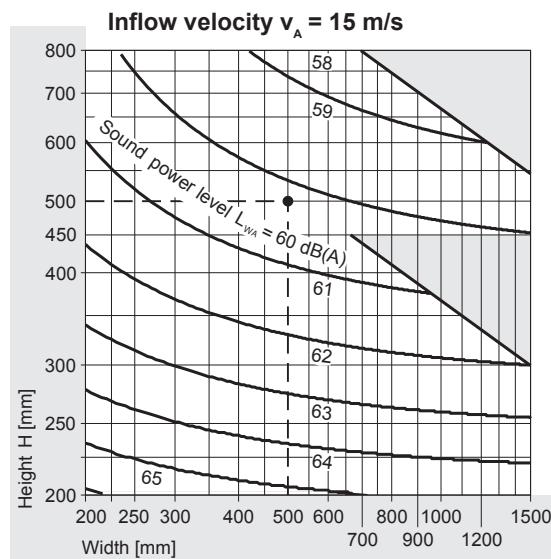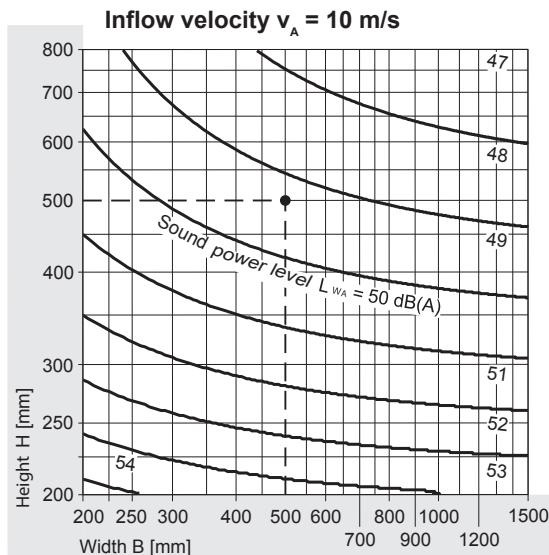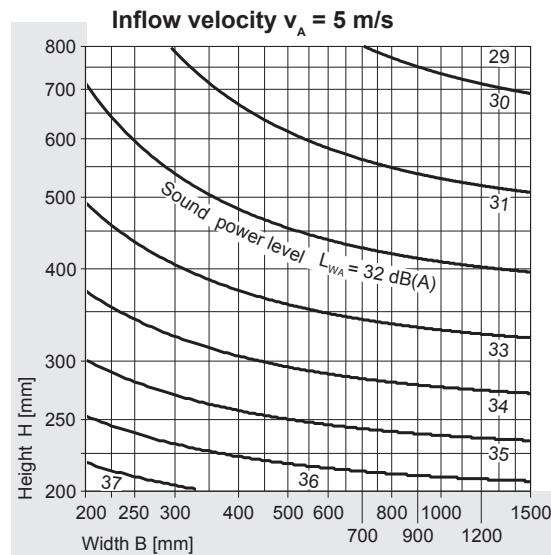

Relative sound power level ΔL [dB]

| f [Hz] | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000 |
|------------------------|----|-----|-----|-----|------|------|------|------|
| $v_A = 5 \text{ m/s}$ | 16 | 8 | 2 | -4 | -8 | -12 | -15 | -19 |
| $v_A = 10 \text{ m/s}$ | 10 | 4 | 1 | -4 | -6 | -9 | -12 | -16 |
| $v_A = 15 \text{ m/s}$ | 5 | 2 | 0 | -4 | -6 | -7 | -11 | -15 |
| $v_A = 20 \text{ m/s}$ | 2 | -1 | -2 | -5 | -6 | -7 | -11 | -14 |

Examples

| | | |
|-------------------------------|---|-----------------------------|
| Width B x height H | = | 500 mm x 500 mm |
| Inflow velocity v_A | = | 10 15 20 m/s |
| Volume flow V | = | 9000 13500 18000 m³/h |
| Pressure drop Δp_s | = | 14 31 56 Pa |
| Sound power level L_{WA} | = | 49 60 68 dB(A) |
| Sound power level L_{W-Oct} | = | $L_{WA} + \Delta L$ |

| Example | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000 Hz |
|---------|----|-----|-----|-----|------|------|------|---------|
| 1 | 59 | 53 | 50 | 45 | 43 | 40 | 37 | 33 [dB] |
| 2 | 65 | 62 | 60 | 56 | 54 | 53 | 49 | 45 [dB] |
| 3 | 70 | 67 | 66 | 63 | 62 | 61 | 57 | 54 [dB] |

Nomenclature ⇒ see page 5

EK90 smoke control dampers can be used, opened and closed with inflow velocities of $v_A \leq 20 \text{ m/s}$.

The inflow velocities for opening are limited to the values given in the table and in the diagrams:

| H \ B | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 | |
|-------|--|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|----|
| 250 | | | | | | | | | | | | | | | | | | | 19 | 19 | 18 | |
| 275 | | | | | | | | | | | | | | | | | | | 19 | 19 | 18 | |
| 300 | | | | | | | | | | | | | | | | | | | 18 | 18 | 17 | |
| 325 | | | | | | | | | | | | | | | | | | | 17 | 17 | 16 | |
| 350 | | | | | | | | | | | | | | | | | | | 16 | 16 | 15 | |
| 375 | | | | | | | | | | | | | | | | | | | 15 | 15 | 14 | |
| 400 | | | | | | | | | | | | | | | | | | | 14 | 14 | 13 | |
| 450 | 19 | 18 | 17 | 16 | 16 | 15 | 15 | 14 | 14 | 13 | 13 | 13 | 12 | 12 | 12 | 11 | 11 | 11 | 10 | 10 | 10 | |
| | $v_A \leq 20 \text{ m/s}$ | | | | | | | | | | | | | | | | | | | | | |
| | In these ranges surrounded by the red border, opening is possible at an inflow velocity of v_A up to 20 m/s with a specially designed electrical connection! ⇒ see page 34 | | | | | | | | | | | | | | | | | | | | | |
| 500 | Example | | | | | | | | | | | | | | | | | | | | | |
| 550 | | | | | | | | | | | | | | | | | | 19 | 19 | 18 | 17 | 16 |
| 600 | | | | | | | | | | | | | | | | | | 17 | 17 | 16 | 15 | 15 |
| 650 | | | | | | | | | | | | | | | | | | 16 | 16 | 15 | 14 | 14 |
| 700 | | | | | | | | | | | | | | | | | | 15 | 15 | 14 | 13 | 13 |
| 750 | | | | | | | | | | | | | | | | | | 14 | 14 | 13 | 12 | 12 |
| 800 | 19 | 18 | 17 | 16 | 16 | 15 | 14 | 14 | 14 | 13 | 13 | 13 | 12 | 12 | 12 | 11 | 11 | 11 | 11 | 11 | 10 | |
| | $v_A \leq 20 \text{ m/s}$ | | | | | | | | | | | | | | | | | | | | | |

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 5 m/s inflow velocity (1)

| H | B = | 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|-------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|
| 200 | m³/h | 720 | 810 | 900 | 990 | 1080 | 1170 | 1260 | 1350 | 1440 | 1620 | 1800 | 1980 | 2160 | 2340 | 2520 |
| | Pa | 17 | 16 | 16 | 15 | 15 | 15 | 14 | 14 | 14 | 14 | 13 | 13 | 13 | 13 | 13 |
| | dB(A) | 38 | 37 | 37 | 37 | 37 | 37 | 37 | 37 | 37 | 37 | 37 | 37 | 37 | 36 | 36 |
| 225 | m³/h | 810 | 911 | 1013 | 1114 | 1215 | 1316 | 1418 | 1519 | 1620 | 1823 | 2025 | 2228 | 2430 | 2633 | 2835 |
| | Pa | 14 | 13 | 13 | 12 | 12 | 12 | 11 | 11 | 11 | 11 | 11 | 11 | 10 | 10 | 10 |
| | dB(A) | 37 | 37 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 |
| 250 | m³/h | 900 | 1013 | 1125 | 1238 | 1350 | 1463 | 1575 | 1688 | 1800 | 2025 | 2250 | 2475 | 2700 | 2925 | 3150 |
| | Pa | 12 | 11 | 11 | 10 | 10 | 10 | 10 | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 8 |
| | dB(A) | 36 | 36 | 36 | 36 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 |
| 275 | m³/h | 990 | 1114 | 1238 | 1361 | 1485 | 1609 | 1733 | 1856 | 1980 | 2228 | 2475 | 2723 | 2970 | 3218 | 3465 |
| | Pa | 10 | 10 | 9 | 9 | 9 | 8 | 8 | 8 | 8 | 8 | 8 | 7 | 7 | 7 | 7 |
| | dB(A) | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 34 | 34 | 34 | 34 | 34 | 34 |
| 300 | m³/h | 1080 | 1215 | 1350 | 1485 | 1620 | 1755 | 1890 | 2025 | 2160 | 2430 | 2700 | 2970 | 3240 | 3510 | 3780 |
| | Pa | 9 | 8 | 8 | 8 | 8 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 6 | 6 | 6 |
| | dB(A) | 35 | 35 | 35 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 |
| 325 | m³/h | 1170 | 1316 | 1463 | 1609 | 1755 | 1901 | 2048 | 2194 | 2340 | 2633 | 2925 | 3218 | 3510 | 3803 | 4095 |
| | Pa | 8 | 8 | 7 | 7 | 7 | 7 | 7 | 7 | 6 | 6 | 6 | 6 | 6 | 6 | 6 |
| | dB(A) | 35 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 33 | 33 | 33 | 33 | 33 |
| 350 | m³/h | 1260 | 1418 | 1575 | 1733 | 1890 | 2048 | 2205 | 2363 | 2520 | 2835 | 3150 | 3465 | 3780 | 4095 | 4410 |
| | Pa | 7 | 7 | 7 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 5 | 5 | 5 | 5 | 5 |
| | dB(A) | 34 | 34 | 34 | 34 | 34 | 34 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 |
| 375 | m³/h | 1350 | 1519 | 1688 | 1856 | 2025 | 2194 | 2363 | 2531 | 2700 | 3038 | 3375 | 3713 | 4050 | 4388 | 4725 |
| | Pa | 7 | 6 | 6 | 6 | 6 | 6 | 6 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 |
| | dB(A) | 34 | 34 | 34 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 |
| 400 | m³/h | 1440 | 1620 | 1800 | 1980 | 2160 | 2340 | 2520 | 2700 | 2880 | 3240 | 3600 | 3960 | 4320 | 4680 | 5040 |
| | Pa | 6 | 6 | 6 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 4 | 4 | 4 | 4 |
| | dB(A) | 34 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 32 | 32 | 32 | 32 | 32 |
| 450 | m³/h | 1620 | 1823 | 2025 | 2228 | 2430 | 2633 | 2835 | 3038 | 3240 | 3645 | 4050 | 4455 | 4860 | 5265 | 5670 |
| | Pa | 6 | 5 | 5 | 5 | 5 | 5 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| | dB(A) | 33 | 33 | 33 | 33 | 33 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 |
| 500 | m³/h | 1800 | 2025 | 2250 | 2475 | 2700 | 2925 | 3150 | 3375 | 3600 | 4050 | 4500 | 4950 | 5400 | 5850 | 6300 |
| | Pa | 5 | 5 | 5 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 3 | 3 | 3 | 3 | 3 |
| | dB(A) | 33 | 33 | 33 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 31 | 31 | 31 |
| 550 | m³/h | 1980 | 2228 | 2475 | 2723 | 2970 | 3218 | 3465 | 3713 | 3960 | 4455 | 4950 | 5445 | 5940 | 6435 | 6930 |
| | Pa | 5 | 4 | 4 | 4 | 4 | 4 | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| | dB(A) | 33 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 31 | 31 | 31 | 31 | 31 | 31 |
| 600 | m³/h | 2160 | 2430 | 2700 | 2970 | 3240 | 3510 | 3780 | 4050 | 4320 | 4860 | 5400 | 5940 | 6480 | 7020 | 7560 |
| | Pa | 4 | 4 | 4 | 4 | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| | dB(A) | 32 | 32 | 32 | 32 | 32 | 32 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 |
| 650 | m³/h | 2340 | 2633 | 2925 | 3218 | 3510 | 3803 | 4095 | 4388 | 4680 | 5265 | 5850 | 6435 | 7020 | 7605 | 8190 |
| | Pa | 4 | 4 | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 2 | 2 |
| | dB(A) | 32 | 32 | 32 | 32 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 |
| 700 | m³/h | 2520 | 2835 | 3150 | 3465 | 3780 | 4095 | 4410 | 4725 | 5040 | 5670 | 6300 | 6930 | 7560 | 8190 | 8820 |
| | Pa | 4 | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 32 | 32 | 32 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 30 | 30 | 30 |
| 750 | m³/h | 2700 | 3038 | 3375 | 3713 | 4050 | 4388 | 4725 | 5063 | 5400 | 6075 | 6750 | 7425 | 8100 | 8775 | 9450 |
| | Pa | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 32 | 32 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 30 | 30 | 30 | 30 | 30 | 30 |
| 800 | m³/h | 2880 | 3240 | 3600 | 3960 | 4320 | 4680 | 5040 | 5400 | 5760 | 6480 | 7200 | 7920 | 8640 | 9360 | 10080 |
| | Pa | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 32 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 30 | 30 | 30 | 30 | 30 | 30 |

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 5 m/s inflow velocity (2)

| H | B = | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 2700 | 2880 | 3060 | 3240 | 3420 | 3600 | 3780 | 3960 | 4140 | 4320 | 4500 | 4680 | 5040 | 5400 |
| | Pa | 13 | 13 | 13 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 |
| | dB(A) | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 | 36 |
| 225 | m³/h | 3038 | 3240 | 3443 | 3645 | 3848 | 4050 | 4253 | 4455 | 4658 | 4860 | 5063 | 5265 | 5670 | 6075 |
| | Pa | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 |
| | dB(A) | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 |
| 250 | m³/h | 3375 | 3600 | 3825 | 4050 | 4275 | 4500 | 4725 | 4950 | 5175 | 5400 | 5625 | 5850 | 6300 | 6750 |
| | Pa | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 |
| | dB(A) | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 34 |
| 275 | m³/h | 3713 | 3960 | 4208 | 4455 | 4703 | 4950 | 5198 | 5445 | 5693 | 5940 | 6188 | 6435 | 6930 | 7425 |
| | Pa | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 |
| | dB(A) | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 | 34 |
| 300 | m³/h | 4050 | 4320 | 4590 | 4860 | 5130 | 5400 | 5670 | 5940 | 6210 | 6480 | 6750 | 7020 | 7560 | 8100 |
| | Pa | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 | 6 |
| | dB(A) | 34 | 34 | 34 | 34 | 34 | 34 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 |
| 325 | m³/h | 4388 | 4680 | 4973 | 5265 | 5558 | 5850 | 6143 | 6435 | 6728 | 7020 | 7313 | 7605 | 8190 | 8775 |
| | Pa | 6 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 |
| | dB(A) | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 |
| 350 | m³/h | 4725 | 5040 | 5355 | 5670 | 5985 | 6300 | 6615 | 6930 | 7245 | 7560 | 7875 | 8190 | 8820 | 9450 |
| | Pa | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 | 5 |
| | dB(A) | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 | 33 |
| 375 | m³/h | 5063 | 5400 | 5738 | 6075 | 6413 | 6750 | 7088 | 7425 | 7763 | 8100 | 8438 | 8775 | 9450 | 10125 |
| | Pa | 5 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| | dB(A) | 33 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 |
| 400 | m³/h | 5400 | 5760 | 6120 | 6480 | 6840 | 7200 | 7560 | 7920 | 8280 | 8640 | 9000 | 9360 | 10080 | 10800 |
| | Pa | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 | 4 |
| | dB(A) | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 |
| 450 | m³/h | 6075 | 6480 | 6885 | 7290 | 7695 | 8100 | 8505 | 8910 | 9315 | 9720 | 10125 | 10530 | 11340 | 12150 |
| | Pa | 4 | 4 | 4 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| | dB(A) | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 31 | 31 | 31 |
| 500 | m³/h | 6750 | 7200 | 7650 | 8100 | 8550 | 9000 | 9450 | 9900 | 10350 | 10800 | 11250 | 11700 | 12600 | 13500 |
| | Pa | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| | dB(A) | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 |
| 550 | m³/h | 7425 | 7920 | 8415 | 8910 | 9405 | 9900 | 10395 | 10890 | 11385 | 11880 | 12375 | 12870 | 13860 | 14850 |
| | Pa | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| | dB(A) | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 |
| 600 | m³/h | 8100 | 8640 | 9180 | 9720 | 10260 | 10800 | 11340 | 11880 | 12420 | 12960 | 13500 | 14040 | 15120 | 16200 |
| | Pa | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 31 | 30 | 30 | 30 | 30 |
| 650 | m³/h | 8775 | 9360 | 9945 | 10530 | 11115 | 11700 | 12285 | 12870 | 13455 | 14040 | 14625 | 15210 | 16380 | 17550 |
| | Pa | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 31 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 |
| 700 | m³/h | 9450 | 10080 | 10710 | 11340 | 11970 | 12600 | 13230 | 13860 | 14490 | 15120 | 15750 | 16380 | 17640 | 18900 |
| | Pa | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 |
| 750 | m³/h | 10125 | 10800 | 11475 | 12150 | 12825 | 13500 | 14175 | 14850 | 15525 | 16200 | 16875 | 17550 | 18900 | 20250 |
| | Pa | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 |
| 800 | m³/h | 10800 | 11520 | 12240 | 12960 | 13680 | 14400 | 15120 | 15840 | 16560 | 17280 | 18000 | 18720 | 20160 | 21600 |
| | Pa | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | dB(A) | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 | 30 |

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 10 m/s inflow velocity (1)

| H | B = | 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|-------|------|------|------|------|------|------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 1440 | 1620 | 1800 | 1980 | 2160 | 2340 | 2520 | 2700 | 2880 | 3240 | 3600 | 3960 | 4320 | 4680 | 5040 |
| | Pa | 67 | 64 | 62 | 61 | 59 | 58 | 57 | 56 | 56 | 54 | 53 | 53 | 52 | 52 | 51 |
| | dB(A) | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 54 | 54 | 54 | 54 | 54 | 54 |
| 225 | m³/h | 1620 | 1823 | 2025 | 2228 | 2430 | 2633 | 2835 | 3038 | 3240 | 3645 | 4050 | 4455 | 4860 | 5265 | 5670 |
| | Pa | 55 | 52 | 50 | 49 | 48 | 47 | 46 | 45 | 44 | 43 | 43 | 42 | 41 | 41 | 41 |
| | dB(A) | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 53 | 53 | 53 | 53 | 53 | 53 |
| 250 | m³/h | 1800 | 2025 | 2250 | 2475 | 2700 | 2925 | 3150 | 3375 | 3600 | 4050 | 4500 | 4950 | 5400 | 5850 | 6300 |
| | Pa | 46 | 44 | 42 | 41 | 40 | 39 | 38 | 38 | 37 | 36 | 36 | 35 | 34 | 34 | 34 |
| | dB(A) | 54 | 54 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 52 |
| 275 | m³/h | 1980 | 2228 | 2475 | 2723 | 2970 | 3218 | 3465 | 3713 | 3960 | 4455 | 4950 | 5445 | 5940 | 6435 | 6930 |
| | Pa | 40 | 38 | 37 | 36 | 35 | 34 | 33 | 32 | 32 | 31 | 30 | 30 | 30 | 29 | 29 |
| | dB(A) | 53 | 53 | 53 | 53 | 53 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 |
| 300 | m³/h | 2160 | 2430 | 2700 | 2970 | 3240 | 3510 | 3780 | 4050 | 4320 | 4860 | 5400 | 5940 | 6480 | 7020 | 7560 |
| | Pa | 36 | 34 | 33 | 31 | 30 | 30 | 29 | 29 | 28 | 27 | 27 | 26 | 26 | 25 | 25 |
| | dB(A) | 53 | 53 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 51 | 51 | 51 | 51 |
| 325 | m³/h | 2340 | 2633 | 2925 | 3218 | 3510 | 3803 | 4095 | 4388 | 4680 | 5265 | 5850 | 6435 | 7020 | 7605 | 8190 |
| | Pa | 32 | 31 | 29 | 28 | 27 | 27 | 26 | 26 | 25 | 24 | 24 | 23 | 23 | 23 | 22 |
| | dB(A) | 52 | 52 | 52 | 52 | 52 | 52 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 |
| 350 | m³/h | 2520 | 2835 | 3150 | 3465 | 3780 | 4095 | 4410 | 4725 | 5040 | 5670 | 6300 | 6930 | 7560 | 8190 | 8820 |
| | Pa | 30 | 28 | 27 | 26 | 25 | 24 | 24 | 23 | 23 | 22 | 21 | 21 | 21 | 20 | 20 |
| | dB(A) | 52 | 52 | 52 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 |
| 375 | m³/h | 2700 | 3038 | 3375 | 3713 | 4050 | 4388 | 4725 | 5063 | 5400 | 6075 | 6750 | 7425 | 8100 | 8775 | 9450 |
| | Pa | 27 | 26 | 25 | 24 | 23 | 22 | 22 | 21 | 21 | 20 | 20 | 19 | 19 | 19 | 18 |
| | dB(A) | 52 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 50 | 50 | 50 | 50 | 50 | 50 |
| 400 | m³/h | 2880 | 3240 | 3600 | 3960 | 4320 | 4680 | 5040 | 5400 | 5760 | 6480 | 7200 | 7920 | 8640 | 9360 | 10080 |
| | Pa | 26 | 24 | 23 | 22 | 21 | 21 | 20 | 20 | 19 | 19 | 18 | 18 | 17 | 17 | 17 |
| | dB(A) | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| 450 | m³/h | 3240 | 3645 | 4050 | 4455 | 4860 | 5265 | 5670 | 6075 | 6480 | 7290 | 8100 | 8910 | 9720 | 10530 | 11340 |
| | Pa | 23 | 21 | 20 | 19 | 19 | 18 | 18 | 17 | 17 | 16 | 16 | 15 | 15 | 15 | 15 |
| | dB(A) | 51 | 51 | 51 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 49 | 49 |
| 500 | m³/h | 3600 | 4050 | 4500 | 4950 | 5400 | 5850 | 6300 | 6750 | 7200 | 8100 | 9000 | 9900 | 10800 | 11700 | 12600 |
| | Pa | 21 | 19 | 18 | 17 | 17 | 16 | 16 | 15 | 15 | 14 | 14 | 14 | 13 | 13 | 13 |
| | dB(A) | 51 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 49 | 49 | 49 | 49 | 49 | 49 |
| 550 | m³/h | 3960 | 4455 | 4950 | 5445 | 5940 | 6435 | 6930 | 7425 | 7920 | 8910 | 9900 | 10890 | 11880 | 12870 | 13860 |
| | Pa | 19 | 18 | 17 | 16 | 15 | 15 | 14 | 14 | 14 | 13 | 13 | 12 | 12 | 12 | 12 |
| | dB(A) | 50 | 50 | 50 | 50 | 50 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 |
| 600 | m³/h | 4320 | 4860 | 5400 | 5940 | 6480 | 7020 | 7560 | 8100 | 8640 | 9720 | 10800 | 11880 | 12960 | 14040 | 15120 |
| | Pa | 18 | 16 | 15 | 15 | 14 | 14 | 13 | 13 | 12 | 12 | 12 | 11 | 11 | 11 | 10 |
| | dB(A) | 50 | 50 | 50 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 48 | 48 | 48 |
| 650 | m³/h | 4680 | 5265 | 5850 | 6435 | 7020 | 7605 | 8190 | 8775 | 9360 | 10530 | 11700 | 12870 | 14040 | 15210 | 16380 |
| | Pa | 17 | 15 | 14 | 14 | 13 | 13 | 12 | 12 | 12 | 11 | 11 | 10 | 10 | 10 | 10 |
| | dB(A) | 50 | 50 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 48 | 48 | 48 | 48 | 48 |
| 700 | m³/h | 5040 | 5670 | 6300 | 6930 | 7560 | 8190 | 8820 | 9450 | 10080 | 11340 | 12600 | 13860 | 15120 | 16380 | 17640 |
| | Pa | 16 | 15 | 14 | 13 | 12 | 12 | 11 | 11 | 11 | 10 | 10 | 9 | 9 | 9 | 9 |
| | dB(A) | 50 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 48 | 48 | 48 | 48 | 48 | 48 | 48 |
| 750 | m³/h | 5400 | 6075 | 6750 | 7425 | 8100 | 8775 | 9450 | 10125 | 10800 | 12150 | 13500 | 14850 | 16200 | 17550 | 18900 |
| | Pa | 15 | 14 | 13 | 12 | 12 | 11 | 11 | 10 | 10 | 10 | 9 | 9 | 9 | 9 | 8 |
| | dB(A) | 50 | 49 | 49 | 49 | 49 | 49 | 49 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 |
| 800 | m³/h | 5760 | 6480 | 7200 | 7920 | 8640 | 9360 | 10080 | 10800 | 11520 | 12960 | 14400 | 15840 | 17280 | 18720 | 20160 |
| | Pa | 14 | 13 | 12 | 12 | 11 | 11 | 10 | 10 | 10 | 9 | 9 | 8 | 8 | 8 | 8 |
| | dB(A) | 49 | 49 | 49 | 49 | 49 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 |

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 10 m/s inflow velocity (2)

| H | B = | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 5400 | 5760 | 6120 | 6480 | 6840 | 7200 | 7560 | 7920 | 8280 | 8640 | 9000 | 9360 | 10080 | 10800 |
| | Pa | 51 | 50 | 50 | 50 | 50 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 48 | 48 |
| | dB(A) | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 | 54 |
| 225 | m³/h | 6075 | 6480 | 6885 | 7290 | 7695 | 8100 | 8505 | 8910 | 9315 | 9720 | 10125 | 10530 | 11340 | 12150 |
| | Pa | 40 | 40 | 40 | 40 | 39 | 39 | 39 | 39 | 39 | 39 | 39 | 38 | 38 | 38 |
| | dB(A) | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 | 53 |
| 250 | m³/h | 6750 | 7200 | 7650 | 8100 | 8550 | 9000 | 9450 | 9900 | 10350 | 10800 | 11250 | 11700 | 12600 | 13500 |
| | Pa | 33 | 33 | 33 | 33 | 33 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 32 | 31 |
| | dB(A) | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 |
| 275 | m³/h | 7425 | 7920 | 8415 | 8910 | 9405 | 9900 | 10395 | 10890 | 11385 | 11880 | 12375 | 12870 | 13860 | 14850 |
| | Pa | 29 | 28 | 28 | 28 | 28 | 28 | 28 | 27 | 27 | 27 | 27 | 27 | 27 | 27 |
| | dB(A) | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 | 52 |
| 300 | m³/h | 8100 | 8640 | 9180 | 9720 | 10260 | 10800 | 11340 | 11880 | 12420 | 12960 | 13500 | 14040 | 15120 | 16200 |
| | Pa | 25 | 25 | 25 | 24 | 24 | 24 | 24 | 24 | 24 | 24 | 24 | 24 | 23 | 23 |
| | dB(A) | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 |
| 325 | m³/h | 8775 | 9360 | 9945 | 10530 | 11115 | 11700 | 12285 | 12870 | 13455 | 14040 | 14625 | 15210 | 16380 | 17550 |
| | Pa | 22 | 22 | 22 | 22 | 21 | 21 | 21 | 21 | 21 | 21 | 21 | 21 | 21 | 21 |
| | dB(A) | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 | 51 |
| 350 | m³/h | 9450 | 10080 | 10710 | 11340 | 11970 | 12600 | 13230 | 13860 | 14490 | 15120 | 15750 | 16380 | 17640 | 18900 |
| | Pa | 20 | 20 | 20 | 19 | 19 | 19 | 19 | 19 | 19 | 19 | 19 | 19 | 19 | 18 |
| | dB(A) | 51 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| 375 | m³/h | 10125 | 10800 | 11475 | 12150 | 12825 | 13500 | 14175 | 14850 | 15525 | 16200 | 16875 | 17550 | 18900 | 20250 |
| | Pa | 18 | 18 | 18 | 18 | 18 | 17 | 17 | 17 | 17 | 17 | 17 | 17 | 17 | 17 |
| | dB(A) | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| 400 | m³/h | 10800 | 11520 | 12240 | 12960 | 13680 | 14400 | 15120 | 15840 | 16560 | 17280 | 18000 | 18720 | 20160 | 21600 |
| | Pa | 17 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 15 | 15 |
| | dB(A) | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| 450 | m³/h | 12150 | 12960 | 13770 | 14580 | 15390 | 16200 | 17010 | 17820 | 18630 | 19440 | 20250 | 21060 | 22680 | 24300 |
| | Pa | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 13 | 13 | 13 | 13 | 13 | 13 |
| | dB(A) | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 |
| 500 | m³/h | 13500 | 14400 | 15300 | 16200 | 17100 | 18000 | 18900 | 19800 | 20700 | 21600 | 22500 | 23400 | 25200 | 27000 |
| | Pa | 13 | 13 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 11 |
| | dB(A) | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 | 49 |
| 550 | m³/h | 14850 | 15840 | 16830 | 17820 | 18810 | 19800 | 20790 | 21780 | 22770 | 23760 | 24750 | 25740 | 27720 | 29700 |
| | Pa | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 10 | 10 | 10 | 10 | 10 |
| | dB(A) | 49 | 49 | 49 | 49 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 |
| 600 | m³/h | 16200 | 17280 | 18360 | 19440 | 20520 | 21600 | 22680 | 23760 | 24840 | 25920 | 27000 | 28080 | 30240 | 32400 |
| | Pa | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 9 | 9 | 9 | 9 | 9 |
| | dB(A) | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 |
| 650 | m³/h | 17550 | 18720 | 19890 | 21060 | 22230 | 23400 | 24570 | 25740 | 26910 | 28080 | 29250 | 30420 | 32760 | 35100 |
| | Pa | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 9 | 8 | 8 |
| | dB(A) | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 |
| 700 | m³/h | 18900 | 20160 | 21420 | 22680 | 23940 | 25200 | 26460 | 27720 | 28980 | 30240 | 31500 | 32760 | 35280 | 37800 |
| | Pa | 9 | 9 | 9 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 |
| | dB(A) | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 48 | 47 | 47 | 47 |
| 750 | m³/h | 20250 | 21600 | 22950 | 24300 | 25650 | 27000 | 28350 | 29700 | 31050 | 32400 | 33750 | 35100 | 37800 | 40500 |
| | Pa | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 7 | 7 | 7 | 7 | 7 | 7 |
| | dB(A) | 48 | 48 | 48 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 |
| 800 | m³/h | 21600 | 23040 | 24480 | 25920 | 27360 | 28800 | 30240 | 31680 | 33120 | 34560 | 36000 | 37440 | 40320 | 43200 |
| | Pa | 8 | 8 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 |
| | dB(A) | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 | 47 |

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 15 m/s inflow velocity (1)

| H | B = | 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|-------|------|------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 2160 | 2430 | 2700 | 2970 | 3240 | 3510 | 3780 | 4050 | 4320 | 4860 | 5400 | 5940 | 6480 | 7020 | 7560 |
| | Pa | 151 | 145 | 140 | 136 | 133 | 131 | 128 | 127 | 125 | 122 | 120 | 118 | 117 | 116 | 115 |
| | dB(A) | 66 | 66 | 66 | 66 | 66 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 |
| 225 | m³/h | 2430 | 2734 | 3038 | 3341 | 3645 | 3949 | 4253 | 4556 | 4860 | 5468 | 6075 | 6683 | 7290 | 7898 | 8505 |
| | Pa | 123 | 118 | 113 | 110 | 107 | 105 | 103 | 101 | 100 | 98 | 96 | 95 | 93 | 92 | 92 |
| | dB(A) | 65 | 65 | 65 | 65 | 65 | 65 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 |
| 250 | m³/h | 2700 | 3038 | 3375 | 3713 | 4050 | 4388 | 4725 | 5063 | 5400 | 6075 | 6750 | 7425 | 8100 | 8775 | 9450 |
| | Pa | 104 | 99 | 95 | 92 | 90 | 88 | 86 | 85 | 84 | 82 | 80 | 79 | 78 | 77 | 76 |
| | dB(A) | 65 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 63 | 63 | 63 | 63 |
| 275 | m³/h | 2970 | 3341 | 3713 | 4084 | 4455 | 4826 | 5198 | 5569 | 5940 | 6683 | 7425 | 8168 | 8910 | 9653 | 10395 |
| | Pa | 91 | 86 | 83 | 80 | 78 | 76 | 74 | 73 | 72 | 70 | 69 | 67 | 66 | 66 | 65 |
| | dB(A) | 64 | 64 | 64 | 64 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 |
| 300 | m³/h | 3240 | 3645 | 4050 | 4455 | 4860 | 5265 | 5670 | 6075 | 6480 | 7290 | 8100 | 8910 | 9720 | 10530 | 11340 |
| | Pa | 81 | 76 | 73 | 71 | 69 | 67 | 65 | 64 | 63 | 61 | 60 | 59 | 58 | 57 | 57 |
| | dB(A) | 64 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 62 | 62 | 62 | 62 | 62 | 62 |
| 325 | m³/h | 3510 | 3949 | 4388 | 4826 | 5265 | 5704 | 6143 | 6581 | 7020 | 7898 | 8775 | 9653 | 10530 | 11408 | 12285 |
| | Pa | 73 | 69 | 66 | 63 | 62 | 60 | 59 | 57 | 56 | 55 | 54 | 52 | 52 | 51 | 50 |
| | dB(A) | 63 | 63 | 63 | 63 | 63 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 |
| 350 | m³/h | 3780 | 4253 | 4725 | 5198 | 5670 | 6143 | 6615 | 7088 | 7560 | 8505 | 9450 | 10395 | 11340 | 12285 | 13230 |
| | Pa | 67 | 63 | 60 | 58 | 56 | 54 | 53 | 52 | 51 | 50 | 48 | 47 | 47 | 46 | 45 |
| | dB(A) | 63 | 63 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 61 |
| 375 | m³/h | 4050 | 4556 | 5063 | 5569 | 6075 | 6581 | 7088 | 7594 | 8100 | 9113 | 10125 | 11138 | 12150 | 13163 | 14175 |
| | Pa | 62 | 58 | 55 | 53 | 51 | 50 | 49 | 48 | 47 | 45 | 44 | 43 | 42 | 42 | 41 |
| | dB(A) | 63 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 61 | 61 | 61 | 61 | 61 | 61 |
| 400 | m³/h | 4320 | 4860 | 5400 | 5940 | 6480 | 7020 | 7560 | 8100 | 8640 | 9720 | 10800 | 11880 | 12960 | 14040 | 15120 |
| | Pa | 58 | 54 | 51 | 49 | 48 | 46 | 45 | 44 | 43 | 42 | 41 | 40 | 39 | 38 | 38 |
| | dB(A) | 62 | 62 | 62 | 62 | 62 | 62 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 |
| 450 | m³/h | 4860 | 5468 | 6075 | 6683 | 7290 | 7898 | 8505 | 9113 | 9720 | 10935 | 12150 | 13365 | 14580 | 15795 | 17010 |
| | Pa | 51 | 48 | 45 | 43 | 42 | 41 | 39 | 39 | 38 | 36 | 35 | 34 | 34 | 33 | 33 |
| | dB(A) | 62 | 62 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 60 | 60 | 60 |
| 500 | m³/h | 5400 | 6075 | 6750 | 7425 | 8100 | 8775 | 9450 | 10125 | 10800 | 12150 | 13500 | 14850 | 16200 | 17550 | 18900 |
| | Pa | 46 | 43 | 41 | 39 | 38 | 36 | 35 | 34 | 34 | 32 | 31 | 31 | 30 | 29 | 29 |
| | dB(A) | 62 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |
| 550 | m³/h | 5940 | 6683 | 7425 | 8168 | 8910 | 9653 | 10395 | 11138 | 11880 | 13365 | 14850 | 16335 | 17820 | 19305 | 20790 |
| | Pa | 43 | 40 | 38 | 36 | 34 | 33 | 32 | 31 | 30 | 29 | 28 | 28 | 27 | 26 | 26 |
| | dB(A) | 61 | 61 | 61 | 61 | 61 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |
| 600 | m³/h | 6480 | 7290 | 8100 | 8910 | 9720 | 10530 | 11340 | 12150 | 12960 | 14580 | 16200 | 17820 | 19440 | 21060 | 22680 |
| | Pa | 40 | 37 | 35 | 33 | 32 | 30 | 30 | 29 | 28 | 27 | 26 | 25 | 25 | 24 | 24 |
| | dB(A) | 61 | 61 | 61 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 59 | 59 | 59 |
| 650 | m³/h | 7020 | 7898 | 8775 | 9653 | 10530 | 11408 | 12285 | 13163 | 14040 | 15795 | 17550 | 19305 | 21060 | 22815 | 24570 |
| | Pa | 37 | 35 | 33 | 31 | 30 | 28 | 27 | 27 | 26 | 25 | 24 | 23 | 23 | 22 | 22 |
| | dB(A) | 61 | 61 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 59 | 59 | 59 | 59 | 59 | 59 |
| 700 | m³/h | 7560 | 8505 | 9450 | 10395 | 11340 | 12285 | 13230 | 14175 | 15120 | 17010 | 18900 | 20790 | 22680 | 24570 | 26460 |
| | Pa | 36 | 33 | 31 | 29 | 28 | 27 | 26 | 25 | 24 | 23 | 22 | 22 | 21 | 21 | 20 |
| | dB(A) | 61 | 60 | 60 | 60 | 60 | 60 | 60 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 |
| 750 | m³/h | 8100 | 9113 | 10125 | 11138 | 12150 | 13163 | 14175 | 15188 | 16200 | 18225 | 20250 | 22275 | 24300 | 26325 | 28350 |
| | Pa | 34 | 31 | 29 | 28 | 26 | 25 | 24 | 24 | 23 | 22 | 22 | 21 | 20 | 19 | 19 |
| | dB(A) | 60 | 60 | 60 | 60 | 60 | 60 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 |
| 800 | m³/h | 8640 | 9720 | 10800 | 11880 | 12960 | 14040 | 15120 | 16200 | 17280 | 19440 | 21600 | 23760 | 25920 | 28080 | |
| | Pa | 32 | 30 | 28 | 26 | 25 | 24 | 23 | 22 | 22 | 21 | 20 | 19 | 19 | 18 | |
| | dB(A) | 60 | 60 | 60 | 60 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | |

This volume flow requires a special
electrical connection design! ⇒ page 34

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 15 m/s inflow velocity (2)

| H | B = | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 8100 | 8640 | 9180 | 9720 | 10260 | 10800 | 11340 | 11880 | 12420 | 12960 | 13500 | 14040 | 15120 | 16200 |
| | Pa | 114 | 113 | 113 | 112 | 112 | 111 | 111 | 110 | 110 | 110 | 109 | 109 | 109 | 108 |
| | dB(A) | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 |
| 225 | m³/h | 9113 | 9720 | 10328 | 10935 | 11543 | 12150 | 12758 | 13365 | 13973 | 14580 | 15188 | 15795 | 17010 | 18225 |
| | Pa | 91 | 90 | 90 | 89 | 89 | 88 | 88 | 88 | 87 | 87 | 87 | 87 | 86 | 86 |
| | dB(A) | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 | 64 |
| 250 | m³/h | 10125 | 10800 | 11475 | 12150 | 12825 | 13500 | 14175 | 14850 | 15525 | 16200 | 16875 | 17550 | 18900 | 20250 |
| | Pa | 75 | 75 | 74 | 74 | 73 | 73 | 73 | 72 | 72 | 72 | 72 | 72 | 71 | 71 |
| | dB(A) | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 |
| 275 | m³/h | 11138 | 11880 | 12623 | 13365 | 14108 | 14850 | 15593 | 16335 | 17078 | 17820 | 18563 | 19305 | 20790 | 22275 |
| | Pa | 64 | 64 | 63 | 63 | 63 | 62 | 62 | 62 | 61 | 61 | 61 | 61 | 61 | 60 |
| | dB(A) | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 63 | 62 | 62 |
| 300 | m³/h | 12150 | 12960 | 13770 | 14580 | 15390 | 16200 | 17010 | 17820 | 18630 | 19440 | 20250 | 21060 | 22680 | 24300 |
| | Pa | 56 | 56 | 55 | 55 | 55 | 54 | 54 | 54 | 53 | 53 | 53 | 53 | 53 | 52 |
| | dB(A) | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 |
| 325 | m³/h | 13163 | 14040 | 14918 | 15795 | 16673 | 17550 | 18428 | 19305 | 20183 | 21060 | 21938 | 22815 | 24570 | 26325 |
| | Pa | 50 | 49 | 49 | 49 | 48 | 48 | 48 | 48 | 47 | 47 | 47 | 47 | 47 | 46 |
| | dB(A) | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 | 62 |
| 350 | m³/h | 14175 | 15120 | 16065 | 17010 | 17955 | 18900 | 19845 | 20790 | 21735 | 22680 | 23625 | 24570 | 26460 | 28350 |
| | Pa | 45 | 44 | 44 | 44 | 43 | 43 | 43 | 43 | 43 | 42 | 42 | 42 | 42 | 42 |
| | dB(A) | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 |
| 375 | m³/h | 15188 | 16200 | 17213 | 18225 | 19238 | 20250 | 21263 | 22275 | 23288 | 24300 | 25313 | 26325 | 28350 | 30375 |
| | Pa | 41 | 40 | 40 | 40 | 39 | 39 | 39 | 39 | 39 | 38 | 38 | 38 | 38 | 38 |
| | dB(A) | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 |
| 400 | m³/h | 16200 | 17280 | 18360 | 19440 | 20520 | 21600 | 22680 | 23760 | 24840 | 25920 | 27000 | 28080 | 30240 | 32400 |
| | Pa | 37 | 37 | 37 | 36 | 36 | 36 | 36 | 36 | 35 | 35 | 35 | 35 | 35 | 34 |
| | dB(A) | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 | 61 |
| 450 | m³/h | 18225 | 19440 | 20655 | 21870 | 23085 | 24300 | 25515 | 26730 | 27945 | 29160 | 30375 | 31590 | 34020 | 36450 |
| | Pa | 32 | 32 | 32 | 31 | 31 | 31 | 31 | 30 | 30 | 30 | 30 | 30 | 30 | 29 |
| | dB(A) | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |
| 500 | m³/h | 20250 | 21600 | 22950 | 24300 | 25650 | 27000 | 28350 | 29700 | 31050 | 32400 | 33750 | 35100 | 37800 | 40500 |
| | Pa | 28 | 28 | 28 | 28 | 27 | 27 | 27 | 27 | 27 | 26 | 26 | 26 | 26 | 26 |
| | dB(A) | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |
| 550 | m³/h | 22275 | 23760 | 25245 | 26730 | 28215 | 29700 | 31185 | 32670 | 34155 | 35640 | 37125 | 38610 | 41580 | |
| | Pa | 26 | 25 | 25 | 25 | 24 | 24 | 24 | 24 | 24 | 23 | 23 | 23 | 23 | |
| | dB(A) | 60 | 60 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | |
| 600 | m³/h | 24300 | 25920 | 27540 | 29160 | 30780 | 32400 | 34020 | 35640 | 37260 | 38880 | | | | |
| | Pa | 23 | 23 | 23 | 22 | 22 | 22 | 22 | 22 | 21 | 21 | | | | |
| | dB(A) | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | 59 | | | | |
| 650 | m³/h | 26325 | 28080 | 29835 | 31590 | 33345 | 35100 | 36855 | | | | | | | |
| | Pa | 21 | 21 | 21 | 21 | 20 | 20 | 20 | | | | | | | |
| | dB(A) | 59 | 59 | 59 | 59 | 59 | 59 | 59 | | | | | | | |
| 700 | m³/h | 28350 | 30240 | 32130 | 34020 | | | | | | | | | | |
| | Pa | 20 | 19 | 19 | 19 | | | | | | | | | | |
| | dB(A) | 59 | 59 | 59 | 59 | | | | | | | | | | |
| 750 | m³/h | 30375 | | | | | | | | | | | | | |
| | Pa | 18 | | | | | | | | | | | | | |
| | dB(A) | 59 | | | | | | | | | | | | | |

The volume flows in the areas marked require
a special electrical connection!

⇒ see page 34

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 20 m/s inflow velocity (1)

| H | B = | 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 2880 | 3240 | 3600 | 3960 | 4320 | 4680 | 5040 | 5400 | 5760 | 6480 | 7200 | 7920 | 8640 | 9360 | 10080 |
| | Pa | 269 | 258 | 249 | 242 | 237 | 232 | 228 | 225 | 222 | 217 | 214 | 211 | 208 | 206 | 204 |
| | dB(A) | 74 | 74 | 74 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 |
| 225 | m³/h | 3240 | 3645 | 4050 | 4455 | 4860 | 5265 | 5670 | 6075 | 6480 | 7290 | 8100 | 8910 | 9720 | 10530 | 11340 |
| | Pa | 219 | 209 | 201 | 196 | 191 | 187 | 183 | 180 | 178 | 174 | 171 | 168 | 166 | 164 | 163 |
| | dB(A) | 73 | 73 | 73 | 73 | 73 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 |
| 250 | m³/h | 3600 | 4050 | 4500 | 4950 | 5400 | 5850 | 6300 | 6750 | 7200 | 8100 | 9000 | 9900 | 10800 | 11700 | 12600 |
| | Pa | 185 | 176 | 170 | 164 | 160 | 156 | 153 | 151 | 149 | 145 | 142 | 140 | 138 | 136 | 135 |
| | dB(A) | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 71 | 71 | 71 | 71 | 71 | 71 |
| 275 | m³/h | 3960 | 4455 | 4950 | 5445 | 5940 | 6435 | 6930 | 7425 | 7920 | 8910 | 9900 | 10890 | 11880 | 12870 | 13860 |
| | Pa | 161 | 153 | 147 | 142 | 138 | 135 | 132 | 130 | 128 | 124 | 122 | 120 | 118 | 117 | 115 |
| | dB(A) | 72 | 72 | 72 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 |
| 300 | m³/h | 4320 | 4860 | 5400 | 5940 | 6480 | 7020 | 7560 | 8100 | 8640 | 9720 | 10800 | 11880 | 12960 | 14040 | 15120 |
| | Pa | 143 | 136 | 130 | 126 | 122 | 119 | 116 | 114 | 112 | 109 | 107 | 105 | 103 | 102 | 101 |
| | dB(A) | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 70 | 70 | 70 | 70 | 70 | 70 |
| 325 | m³/h | 4680 | 5265 | 5850 | 6435 | 7020 | 7605 | 8190 | 8775 | 9360 | 10530 | 11700 | 12870 | 14040 | 15210 | 16380 |
| | Pa | 129 | 122 | 117 | 113 | 109 | 107 | 104 | 102 | 100 | 97 | 95 | 93 | 92 | 91 | 89 |
| | dB(A) | 71 | 71 | 71 | 71 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 |
| 350 | m³/h | 5040 | 5670 | 6300 | 6930 | 7560 | 8190 | 8820 | 9450 | 10080 | 11340 | 12600 | 13860 | 15120 | 16380 | 17640 |
| | Pa | 118 | 112 | 107 | 103 | 99 | 97 | 94 | 93 | 91 | 88 | 86 | 84 | 83 | 82 | 81 |
| | dB(A) | 71 | 71 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 69 | 69 | 69 |
| 375 | m³/h | 5400 | 6075 | 6750 | 7425 | 8100 | 8775 | 9450 | 10125 | 10800 | 12150 | 13500 | 14850 | 16200 | 17550 | 18900 |
| | Pa | 110 | 103 | 98 | 95 | 91 | 89 | 87 | 85 | 83 | 81 | 79 | 77 | 75 | 74 | 73 |
| | dB(A) | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 69 | 69 | 69 | 69 | 69 | 69 | 69 |
| 400 | m³/h | 5760 | 6480 | 7200 | 7920 | 8640 | 9360 | 10080 | 10800 | 11520 | 12960 | 14400 | 15840 | 17280 | 18720 | 20160 |
| | Pa | 102 | 96 | 91 | 88 | 85 | 82 | 80 | 78 | 77 | 74 | 72 | 71 | 69 | 68 | 67 |
| | dB(A) | 70 | 70 | 70 | 70 | 70 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 |
| 450 | m³/h | 6480 | 7290 | 8100 | 8910 | 9720 | 10530 | 11340 | 12150 | 12960 | 14580 | 16200 | 17820 | 19440 | 21060 | 22680 |
| | Pa | 91 | 85 | 81 | 77 | 74 | 72 | 70 | 68 | 67 | 65 | 63 | 61 | 60 | 59 | 58 |
| | dB(A) | 70 | 70 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 68 | 68 | 68 | 68 |
| 500 | m³/h | 7200 | 8100 | 9000 | 9900 | 10800 | 11700 | 12600 | 13500 | 14400 | 16200 | 18000 | 19800 | 21600 | 23400 | 25200 |
| | Pa | 82 | 77 | 73 | 69 | 67 | 65 | 63 | 61 | 60 | 58 | 56 | 54 | 53 | 52 | 51 |
| | dB(A) | 69 | 69 | 69 | 69 | 69 | 69 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 |
| 550 | m³/h | 7920 | 8910 | 9900 | 10890 | 11880 | 12870 | 13860 | 14850 | 15840 | 17820 | 19800 | 21780 | 23760 | 25740 | 27720 |
| | Pa | 76 | 71 | 67 | 63 | 61 | 59 | 57 | 55 | 54 | 52 | 50 | 49 | 48 | 47 | 46 |
| | dB(A) | 69 | 69 | 69 | 69 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 |
| 600 | m³/h | 8640 | 9720 | 10800 | 11880 | 12960 | 14040 | 15120 | 16200 | 17280 | 19440 | 21600 | 23760 | 25920 | 28080 | |
| | Pa | 71 | 66 | 62 | 59 | 56 | 54 | 52 | 51 | 50 | 48 | 46 | 45 | 44 | 43 | |
| | dB(A) | 69 | 69 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 67 | 67 | 67 | |
| 650 | m³/h | 9360 | 10530 | 11700 | 12870 | 14040 | 15210 | 16380 | 17550 | 18720 | 21060 | 23400 | 25740 | | | |
| | Pa | 67 | 62 | 58 | 55 | 52 | 50 | 49 | 47 | 46 | 44 | 43 | 41 | | | |
| | dB(A) | 69 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 67 | 67 | 67 | | | |
| 700 | m³/h | 10080 | 11340 | 12600 | 13860 | 15120 | 16380 | 17640 | 18900 | 20160 | 22680 | 25200 | | | | |
| | Pa | 63 | 58 | 55 | 52 | 49 | 47 | 46 | 44 | 43 | 41 | 40 | | | | |
| | dB(A) | 69 | 68 | 68 | 68 | 68 | 68 | 68 | 67 | 67 | 67 | 67 | | | | |
| 750 | m³/h | 10800 | 12150 | 13500 | 14850 | 16200 | 17550 | 18900 | 20250 | 21600 | | | | | | |
| | Pa | 60 | 56 | 52 | 49 | 47 | 45 | 43 | 42 | 41 | | | | | | |
| | dB(A) | 68 | 68 | 68 | 68 | 68 | 67 | 67 | 67 | 67 | | | | | | |
| 800 | m³/h | 11520 | 12960 | 14400 | 15840 | 17280 | 18720 | 20160 | 21600 | | | | | | | |
| | Pa | 58 | 53 | 50 | 47 | 45 | 43 | 41 | 40 | | | | | | | |
| | dB(A) | 68 | 68 | 68 | 68 | 67 | 67 | 67 | 67 | | | | | | | |

The volume flows in the areas marked require
a special electrical connection design!
⇒ see page 34

EK90 smoke control dampers

Volume flow, pressure drop, sound power level at 20 m/s inflow velocity (2)

| H | B = | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | m³/h | 10800 | 11520 | 12240 | 12960 | 13680 | 14400 | 15120 | 15840 | 16560 | 17280 | 18000 | 18720 | 20160 | 21600 |
| | Pa | 203 | 202 | 200 | 199 | 198 | 198 | 197 | 196 | 196 | 195 | 195 | 194 | 193 | 193 |
| | dB(A) | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 | 73 |
| 225 | m³/h | 12150 | 12960 | 13770 | 14580 | 15390 | 16200 | 17010 | 17820 | 18630 | 19440 | 20250 | 21060 | 22680 | 24300 |
| | Pa | 161 | 160 | 159 | 158 | 158 | 157 | 156 | 156 | 155 | 155 | 154 | 154 | 153 | 153 |
| | dB(A) | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 | 72 |
| 250 | m³/h | 13500 | 14400 | 15300 | 16200 | 17100 | 18000 | 18900 | 19800 | 20700 | 21600 | 22500 | 23400 | 25200 | 27000 |
| | Pa | 134 | 133 | 132 | 131 | 130 | 130 | 129 | 129 | 128 | 128 | 128 | 127 | 127 | 126 |
| | dB(A) | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 | 71 |
| 275 | m³/h | 14850 | 15840 | 16830 | 17820 | 18810 | 19800 | 20790 | 21780 | 22770 | 23760 | 24750 | 25740 | 27720 | 29700 |
| | Pa | 114 | 113 | 113 | 112 | 111 | 111 | 110 | 110 | 109 | 109 | 109 | 108 | 108 | 107 |
| | dB(A) | 71 | 71 | 71 | 71 | 71 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 |
| 300 | m³/h | 16200 | 17280 | 18360 | 19440 | 20520 | 21600 | 22680 | 23760 | 24840 | 25920 | 27000 | 28080 | 30240 | 32400 |
| | Pa | 100 | 99 | 98 | 97 | 97 | 96 | 96 | 95 | 95 | 95 | 94 | 94 | 94 | 93 |
| | dB(A) | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 |
| 325 | m³/h | 17550 | 18720 | 19890 | 21060 | 22230 | 23400 | 24570 | 25740 | 26910 | 28080 | 29250 | 30420 | 32760 | 35100 |
| | Pa | 89 | 88 | 87 | 86 | 86 | 85 | 85 | 85 | 84 | 84 | 84 | 83 | 83 | 82 |
| | dB(A) | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 69 | 69 | 69 | 69 |
| 350 | m³/h | 18900 | 20160 | 21420 | 22680 | 23940 | 25200 | 26460 | 27720 | 28980 | 30240 | 31500 | 32760 | 35280 | 37800 |
| | Pa | 80 | 79 | 78 | 78 | 77 | 77 | 76 | 76 | 76 | 75 | 75 | 75 | 74 | 74 |
| | dB(A) | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 |
| 375 | m³/h | 20250 | 21600 | 22950 | 24300 | 25650 | 27000 | 28350 | 29700 | 31050 | 32400 | 33750 | 35100 | 37800 | 40500 |
| | Pa | 73 | 72 | 71 | 71 | 70 | 70 | 69 | 69 | 69 | 68 | 68 | 68 | 67 | 67 |
| | dB(A) | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 |
| 400 | m³/h | 21600 | 23040 | 24480 | 25920 | 27360 | 28800 | 30240 | 31680 | 33120 | 34560 | 36000 | 37440 | 40320 | 43200 |
| | Pa | 67 | 66 | 65 | 65 | 64 | 64 | 63 | 63 | 63 | 62 | 62 | 62 | 62 | 61 |
| | dB(A) | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 69 | 68 | 68 | 68 |
| 450 | m³/h | 24300 | 25920 | 27540 | 29160 | 30780 | 32400 | 34020 | 35640 | 37260 | 38880 | | | | |
| | Pa | 57 | 57 | 56 | 56 | 55 | 55 | 54 | 54 | 54 | 54 | | | | |
| | dB(A) | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | | | | |
| 500 | m³/h | 27000 | 28800 | 30600 | 32400 | 34200 | 36000 | | | | | | | | |
| | Pa | 51 | 50 | 49 | 49 | 49 | 48 | | | | | | | | |
| | dB(A) | 68 | 68 | 68 | 68 | 68 | 68 | | | | | | | | |
| 550 | m³/h | 29700 | 31680 | | | | | | | | | | | | |
| | Pa | 45 | 45 | | | | | | | | | | | | |
| | dB(A) | 68 | 67 | | | | | | | | | | | | |

The volume flows in the areas marked require
a special electrical connection design!
⇒ see page 34

EK90 smoke control dampers

Free cross-sections

Free cross-sections A_{free} [m^2]

| H | B = 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|---------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | 0.023 | 0.027 | 0.030 | 0.033 | 0.036 | 0.040 | 0.043 | 0.046 | 0.049 | 0.056 | 0.062 | 0.069 | 0.075 | 0.082 | 0.088 |
| 225 | 0.028 | 0.032 | 0.036 | 0.040 | 0.043 | 0.047 | 0.051 | 0.055 | 0.059 | 0.067 | 0.074 | 0.082 | 0.090 | 0.098 | 0.105 |
| 250 | 0.032 | 0.037 | 0.041 | 0.046 | 0.050 | 0.055 | 0.059 | 0.064 | 0.068 | 0.077 | 0.086 | 0.095 | 0.104 | 0.113 | 0.122 |
| 275 | 0.037 | 0.042 | 0.047 | 0.052 | 0.057 | 0.063 | 0.068 | 0.073 | 0.078 | 0.088 | 0.098 | 0.109 | 0.119 | 0.129 | 0.139 |
| 300 | 0.041 | 0.047 | 0.053 | 0.059 | 0.064 | 0.070 | 0.076 | 0.082 | 0.087 | 0.099 | 0.110 | 0.122 | 0.133 | 0.145 | 0.156 |
| 325 | 0.046 | 0.052 | 0.059 | 0.065 | 0.071 | 0.078 | 0.084 | 0.091 | 0.097 | 0.110 | 0.122 | 0.135 | 0.148 | 0.161 | 0.173 |
| 350 | 0.050 | 0.057 | 0.064 | 0.071 | 0.078 | 0.085 | 0.092 | 0.099 | 0.106 | 0.120 | 0.134 | 0.148 | 0.162 | 0.176 | 0.190 |
| 375 | 0.055 | 0.063 | 0.070 | 0.078 | 0.085 | 0.093 | 0.101 | 0.108 | 0.116 | 0.131 | 0.146 | 0.162 | 0.177 | 0.192 | 0.207 |
| 400 | 0.059 | 0.068 | 0.076 | 0.084 | 0.092 | 0.101 | 0.109 | 0.117 | 0.125 | 0.142 | 0.158 | 0.175 | 0.191 | 0.208 | 0.224 |
| 450 | 0.068 | 0.078 | 0.087 | 0.097 | 0.106 | 0.116 | 0.125 | 0.135 | 0.144 | 0.163 | 0.182 | 0.201 | 0.220 | 0.239 | 0.258 |
| 500 | 0.077 | 0.088 | 0.099 | 0.110 | 0.120 | 0.131 | 0.142 | 0.153 | 0.163 | 0.185 | 0.206 | 0.228 | 0.249 | 0.271 | 0.292 |
| 550 | 0.086 | 0.098 | 0.110 | 0.122 | 0.134 | 0.146 | 0.158 | 0.170 | 0.182 | 0.206 | 0.230 | 0.254 | 0.278 | 0.302 | 0.326 |
| 600 | 0.095 | 0.109 | 0.122 | 0.135 | 0.148 | 0.162 | 0.175 | 0.188 | 0.201 | 0.228 | 0.254 | 0.281 | 0.307 | 0.334 | 0.360 |
| 650 | 0.104 | 0.119 | 0.133 | 0.148 | 0.162 | 0.177 | 0.191 | 0.206 | 0.220 | 0.249 | 0.278 | 0.307 | 0.336 | 0.365 | 0.394 |
| 700 | 0.113 | 0.129 | 0.145 | 0.161 | 0.176 | 0.192 | 0.208 | 0.224 | 0.239 | 0.271 | 0.302 | 0.334 | 0.365 | 0.397 | 0.428 |
| 750 | 0.122 | 0.139 | 0.156 | 0.173 | 0.190 | 0.207 | 0.224 | 0.241 | 0.258 | 0.292 | 0.326 | 0.360 | 0.394 | 0.428 | 0.462 |
| 800 | 0.131 | 0.150 | 0.168 | 0.186 | 0.204 | 0.223 | 0.241 | 0.259 | 0.277 | 0.314 | 0.350 | 0.387 | 0.423 | 0.460 | 0.496 |

| H | B = 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|---------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| 200 | 0.095 | 0.101 | 0.108 | 0.114 | 0.121 | 0.127 | 0.134 | 0.140 | 0.147 | 0.153 | 0.160 | 0.166 | 0.179 | 0.192 |
| 225 | 0.113 | 0.121 | 0.129 | 0.136 | 0.144 | 0.152 | 0.160 | 0.167 | 0.175 | 0.183 | 0.191 | 0.198 | 0.214 | 0.229 |
| 250 | 0.131 | 0.140 | 0.149 | 0.158 | 0.167 | 0.176 | 0.185 | 0.194 | 0.203 | 0.212 | 0.221 | 0.230 | 0.248 | 0.266 |
| 275 | 0.150 | 0.160 | 0.170 | 0.180 | 0.191 | 0.201 | 0.211 | 0.221 | 0.232 | 0.242 | 0.252 | 0.262 | 0.283 | 0.303 |
| 300 | 0.168 | 0.179 | 0.191 | 0.202 | 0.214 | 0.225 | 0.237 | 0.248 | 0.260 | 0.271 | 0.283 | 0.294 | 0.317 | 0.340 |
| 325 | 0.186 | 0.199 | 0.212 | 0.224 | 0.237 | 0.250 | 0.263 | 0.275 | 0.288 | 0.301 | 0.314 | 0.326 | 0.352 | 0.377 |
| 350 | 0.204 | 0.218 | 0.232 | 0.246 | 0.260 | 0.274 | 0.288 | 0.302 | 0.316 | 0.330 | 0.344 | 0.358 | 0.386 | 0.414 |
| 375 | 0.223 | 0.238 | 0.253 | 0.268 | 0.284 | 0.299 | 0.314 | 0.329 | 0.345 | 0.360 | 0.375 | 0.390 | 0.421 | 0.451 |
| 400 | 0.241 | 0.257 | 0.274 | 0.290 | 0.307 | 0.323 | 0.340 | 0.356 | 0.373 | 0.389 | 0.406 | 0.422 | 0.455 | 0.488 |
| 450 | 0.277 | 0.296 | 0.315 | 0.334 | 0.353 | 0.372 | 0.391 | 0.410 | 0.429 | 0.448 | 0.467 | 0.486 | 0.524 | 0.562 |
| 500 | 0.314 | 0.335 | 0.357 | 0.378 | 0.400 | 0.421 | 0.443 | 0.464 | 0.486 | 0.507 | 0.529 | 0.550 | 0.593 | 0.636 |
| 550 | 0.350 | 0.374 | 0.398 | 0.422 | 0.446 | 0.470 | 0.494 | 0.518 | 0.542 | 0.566 | 0.590 | 0.614 | 0.662 | 0.710 |
| 600 | 0.387 | 0.413 | 0.440 | 0.466 | 0.493 | 0.519 | 0.546 | 0.572 | 0.599 | 0.625 | 0.652 | 0.678 | 0.731 | 0.784 |
| 650 | 0.423 | 0.452 | 0.481 | 0.510 | 0.539 | 0.568 | 0.597 | 0.626 | 0.655 | 0.684 | 0.713 | 0.742 | 0.800 | 0.858 |
| 700 | 0.460 | 0.491 | 0.523 | 0.554 | 0.586 | 0.617 | 0.649 | 0.680 | 0.712 | 0.743 | 0.775 | 0.806 | 0.869 | 0.932 |
| 750 | 0.496 | 0.530 | 0.564 | 0.598 | 0.632 | 0.666 | 0.700 | 0.734 | 0.768 | 0.802 | 0.836 | 0.870 | 0.938 | 1.006 |
| 800 | 0.533 | 0.569 | 0.606 | 0.642 | 0.679 | 0.715 | 0.752 | 0.788 | 0.825 | 0.861 | 0.898 | 0.934 | 1.007 | 1.080 |

EK90 smoke control dampers

Weights

Weights [kg] for the length L = 500 mm

| H | B = 200 | 225 | 250 | 275 | 300 | 325 | 350 | 375 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|-----|---------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| 200 | 39 | 40 | 41 | 42 | 44 | 45 | 46 | 47 | 49 | 51 | 53 | 56 | 58 | 61 | 63 |
| 225 | 40 | 41 | 42 | 44 | 45 | 46 | 47 | 49 | 50 | 52 | 55 | 57 | 60 | 62 | 65 |
| 250 | 41 | 42 | 44 | 45 | 46 | 48 | 49 | 50 | 51 | 54 | 56 | 59 | 61 | 64 | 67 |
| 275 | 42 | 44 | 45 | 46 | 48 | 49 | 50 | 51 | 53 | 55 | 58 | 60 | 63 | 66 | 68 |
| 300 | 44 | 45 | 46 | 48 | 49 | 50 | 52 | 53 | 54 | 57 | 59 | 62 | 65 | 67 | 70 |
| 325 | 45 | 46 | 48 | 49 | 50 | 52 | 53 | 54 | 55 | 58 | 61 | 63 | 66 | 69 | 71 |
| 350 | 46 | 47 | 49 | 50 | 52 | 53 | 54 | 56 | 57 | 60 | 62 | 65 | 68 | 70 | 73 |
| 375 | 47 | 49 | 50 | 51 | 53 | 54 | 56 | 57 | 58 | 61 | 64 | 66 | 69 | 72 | 75 |
| 400 | 49 | 50 | 51 | 53 | 54 | 55 | 57 | 58 | 60 | 62 | 65 | 68 | 71 | 73 | 76 |
| 450 | 51 | 52 | 54 | 55 | 57 | 58 | 60 | 61 | 62 | 65 | 68 | 71 | 74 | 77 | 80 |
| 500 | 53 | 55 | 56 | 58 | 59 | 61 | 62 | 64 | 65 | 68 | 71 | 74 | 77 | 80 | 83 |
| 550 | 56 | 57 | 59 | 60 | 62 | 63 | 65 | 66 | 68 | 71 | 74 | 77 | 80 | 83 | 86 |
| 600 | 58 | 60 | 61 | 63 | 65 | 66 | 68 | 69 | 71 | 74 | 77 | 80 | 83 | 86 | 89 |
| 650 | 61 | 62 | 64 | 66 | 67 | 69 | 70 | 72 | 73 | 77 | 80 | 83 | 86 | 89 | 92 |
| 700 | 63 | 65 | 67 | 68 | 70 | 71 | 73 | 75 | 76 | 80 | 83 | 86 | 89 | 92 | 96 |
| 750 | 66 | 67 | 69 | 71 | 72 | 74 | 76 | 77 | 79 | 82 | 86 | 89 | 92 | 96 | 99 |
| 800 | 68 | 70 | 72 | 73 | 75 | 77 | 78 | 80 | 82 | 85 | 89 | 92 | 95 | 99 | 102 |

| H | B = 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | 1250 | 1300 | 1400 | 1500 |
|-----|---------|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|
| 200 | 66 | 68 | 71 | 73 | 76 | 78 | 80 | 83 | 85 | 88 | 90 | 93 | 98 | 102 |
| 225 | 67 | 70 | 72 | 75 | 77 | 80 | 82 | 85 | 87 | 90 | 92 | 95 | 100 | 105 |
| 250 | 69 | 72 | 74 | 77 | 79 | 82 | 84 | 87 | 89 | 92 | 94 | 97 | 102 | 107 |
| 275 | 71 | 73 | 76 | 78 | 81 | 84 | 86 | 89 | 91 | 94 | 96 | 99 | 104 | 109 |
| 300 | 72 | 75 | 78 | 80 | 83 | 85 | 88 | 91 | 93 | 96 | 98 | 101 | 106 | 111 |
| 325 | 74 | 77 | 79 | 82 | 85 | 87 | 90 | 93 | 95 | 98 | 101 | 103 | 108 | 114 |
| 350 | 76 | 78 | 81 | 84 | 86 | 89 | 92 | 95 | 97 | 100 | 103 | 105 | 111 | 116 |
| 375 | 77 | 80 | 83 | 86 | 88 | 91 | 94 | 96 | 99 | 102 | 105 | 107 | 113 | 118 |
| 400 | 79 | 82 | 85 | 87 | 90 | 93 | 96 | 98 | 101 | 104 | 107 | 109 | 115 | 121 |
| 450 | 82 | 85 | 88 | 91 | 94 | 97 | 99 | 102 | 105 | 108 | 111 | 114 | 119 | 125 |
| 500 | 86 | 89 | 92 | 94 | 97 | 100 | 103 | 106 | 109 | 112 | 115 | 118 | 124 | 130 |
| 550 | 89 | 92 | 95 | 98 | 101 | 104 | 107 | 110 | 113 | 116 | 119 | 122 | 128 | 134 |
| 600 | 92 | 95 | 99 | 102 | 105 | 108 | 111 | 114 | 117 | 120 | 123 | 126 | 132 | 139 |
| 650 | 96 | 99 | 102 | 105 | 108 | 112 | 115 | 118 | 121 | 124 | 127 | 131 | 137 | 143 |
| 700 | 99 | 102 | 105 | 109 | 112 | 115 | 118 | 122 | 125 | 128 | 131 | 135 | 141 | 148 |
| 750 | 102 | 106 | 109 | 112 | 116 | 119 | 122 | 126 | 129 | 132 | 136 | 139 | 146 | 152 |
| 800 | 106 | 109 | 112 | 116 | 119 | 123 | 126 | 130 | 133 | 136 | 140 | 143 | 150 | 157 |

The weights for other lengths L can be calculated with sufficient accuracy:


Length L: 350 mm: Factor 0.85 or -15%
 400 mm: Factor 0.90 or -10%
 450 mm: Factor 0.95 or -5%
500 mm: Factor 1.00 or 0%
 600 mm: Factor 1.10 or +10%
 700 mm: Factor 1.20 or +20%
 800 mm: Factor 1.30 or +30%
 850 mm: Factor 1.35 or +35%

EK90 smoke control dampers


Installation in rigid walls and ceilings (1) General

The installation in rigid walls and ceilings from a thickness of 100 mm is performed as wet installation using mortar. Gaps of up to 25 mm in width can also be filled with mineral wool $\geq 100 \text{ kg/m}^3$ and $\geq 1000^\circ\text{C}$ melting point. **Shear protection brackets A** protect installation at the rear. Alternatively, **shear protection brackets B** can be used, especially if the installation openings are only accessible from the front, i.e. from the drive side, such as is the case with shaft walls.


Installation in rigid walls

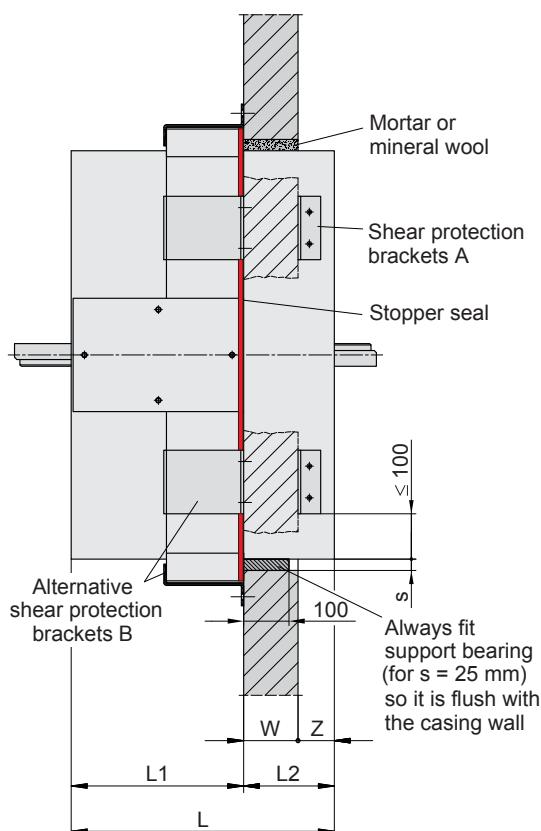




Vertical installation in ceilings (motor drive above ceiling)

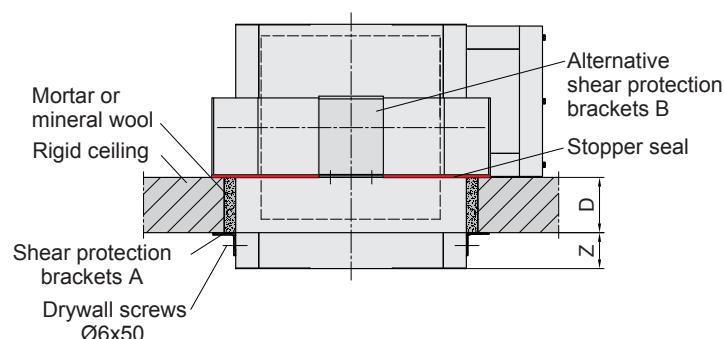

Suspended installation in ceilings (motor drive underneath the ceiling)

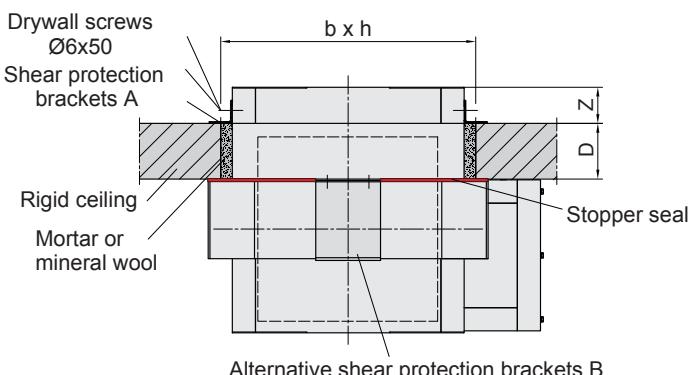

Installation direction →

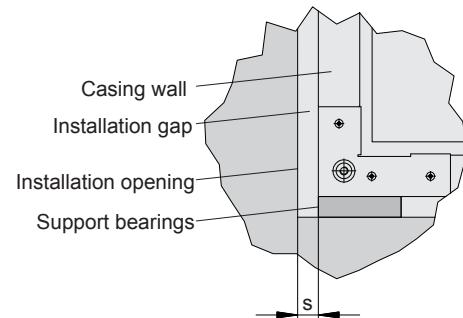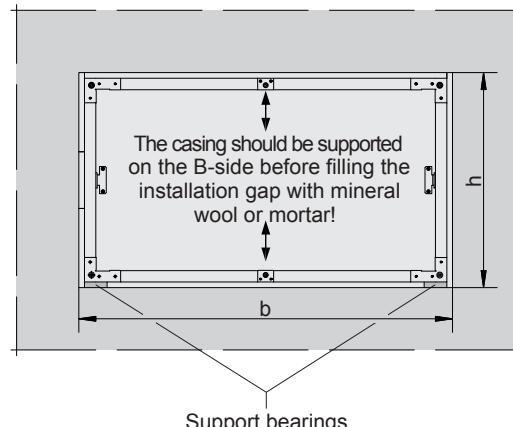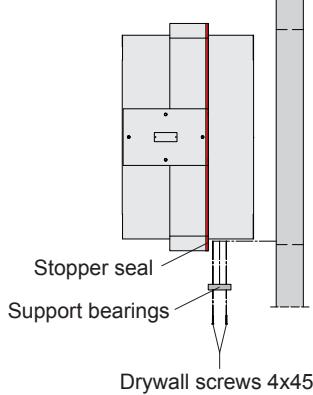

All dimensions in mm



Installation in rigid walls and ceilings

- Outer dimensions of the smoke control dampers in the installation area of the wall or ceiling: $(B + 100 \text{ mm}) \times (H + 100 \text{ mm})$.
- Installation opening in rigid walls and ceilings $b \times h = (B + 100 \text{ mm} + 2 \cdot s [\text{mm}]) \times (H + 100 \text{ mm} + 2 \cdot s [\text{mm}])$
- Mortar gap for wet installation $s \geq 25 \text{ mm}$.
- Gap for mineral wool filling $s = 10 \text{ to } 25 \text{ mm}$.
- Calcium silicate support bearings with the dimensions $100 \text{ mm} \times 100 \text{ mm} \times 25 \text{ mm}$ for gaps $s = 25 \text{ mm}$ are included in delivery. Support bearings must always be used as supports when performing dry installation with mineral wool in walls, and as centring devices in ceilings. In other circumstances, support bearings can be used as installation aids, except in metal stud walls.


EK90 smoke control dampers

Installation in rigid walls and ceilings (2) Attachment with shear protection brackets A and B



Shear protection brackets A are fitted onto the non-drive operation (rear) of the smoke control damper and are attached to the casing or the smoke extraction duct with 2 drywall screws measuring 6 x 50 mm.

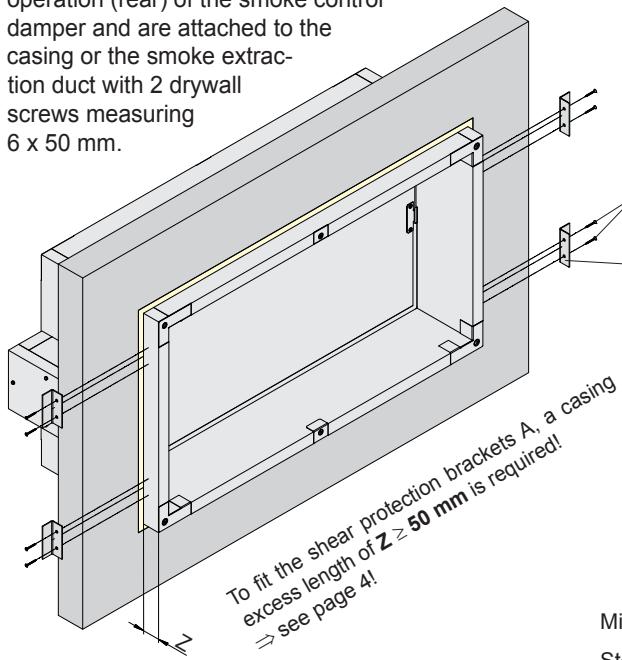

Shear protection brackets A can also be fitted to **flashing strips** on connected smoke extraction ducts.

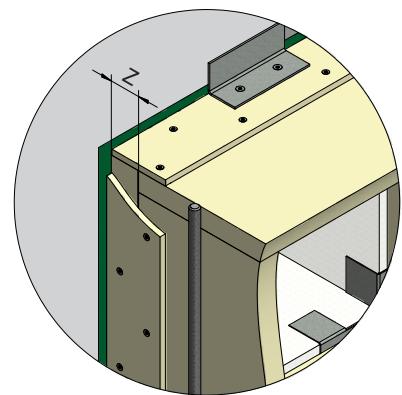

Shear protection brackets B are fitted onto the operation-side (front) of the smoke control damper and are attached using M8 threaded rods and nuts that pass through the wall or ceiling. Dowel attachment ⇒ see page 28

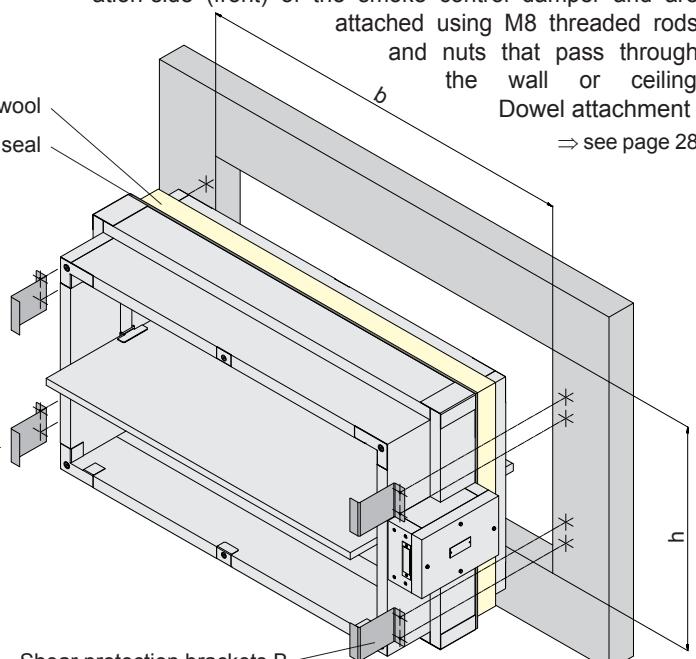
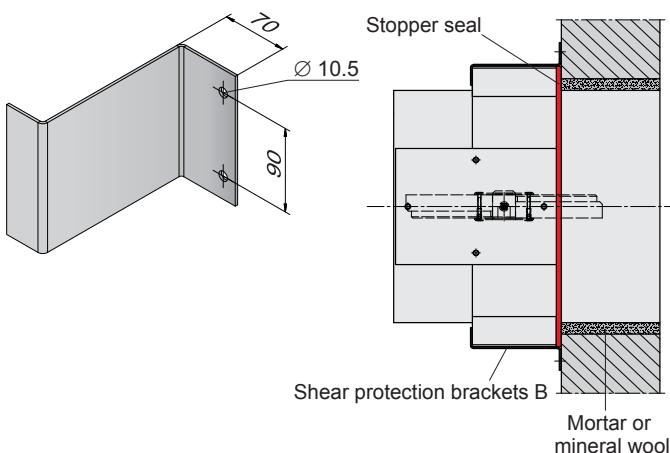


All dimensions in mm


Number and arrangement of shear protection brackets A and B

EK90 smoke control dampers in the sizes B x H

- up to a maximum of 450 mm x 450 mm each damper features 1 shear protection bracket at the centre of the two B-sides or the two H-sides.
- with B > 450 mm or H > 450 mm each damper features 2 shear protection brackets, one on each end of the B-sides or the H-sides.




lengths L > 600 mm, each damper features 1 additional shear protection bracket at the centre of the B- or H-sides.





Shear protection brackets A and B can also be used in combination, while retaining the same total number of brackets!

Shear protection brackets B
View of the front side




Shear protection brackets A
View of the rear side



EK90 smoke control dampers


Installation in rigid walls and ceilings (3)

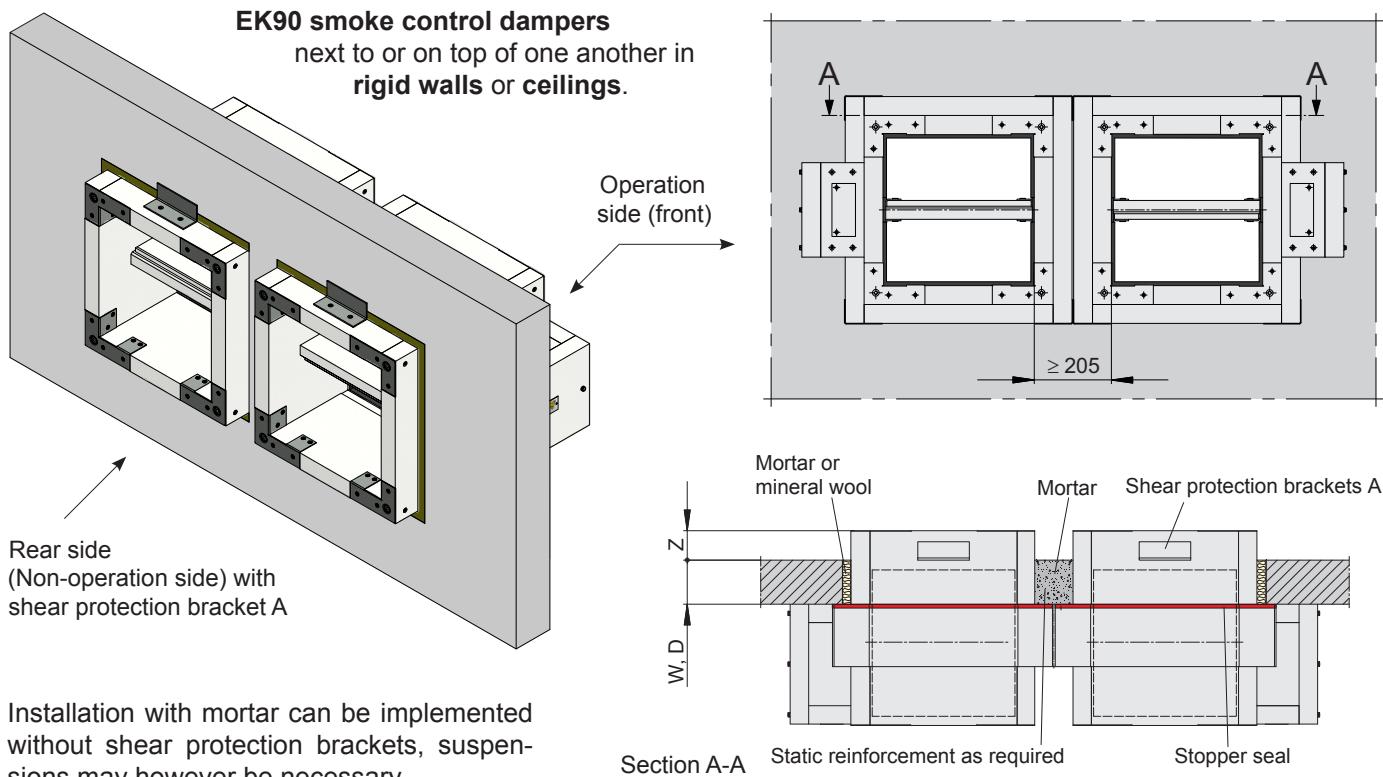

EK90 smoke control dampers underneath rigid ceilings

Installation gaps $s \leq 25$ mm can be filled with mineral wool. Otherwise, installation gaps should be completely filled with mortar!

Shear protection brackets are required for installation with mineral wool, but can be omitted for installation with mortar!

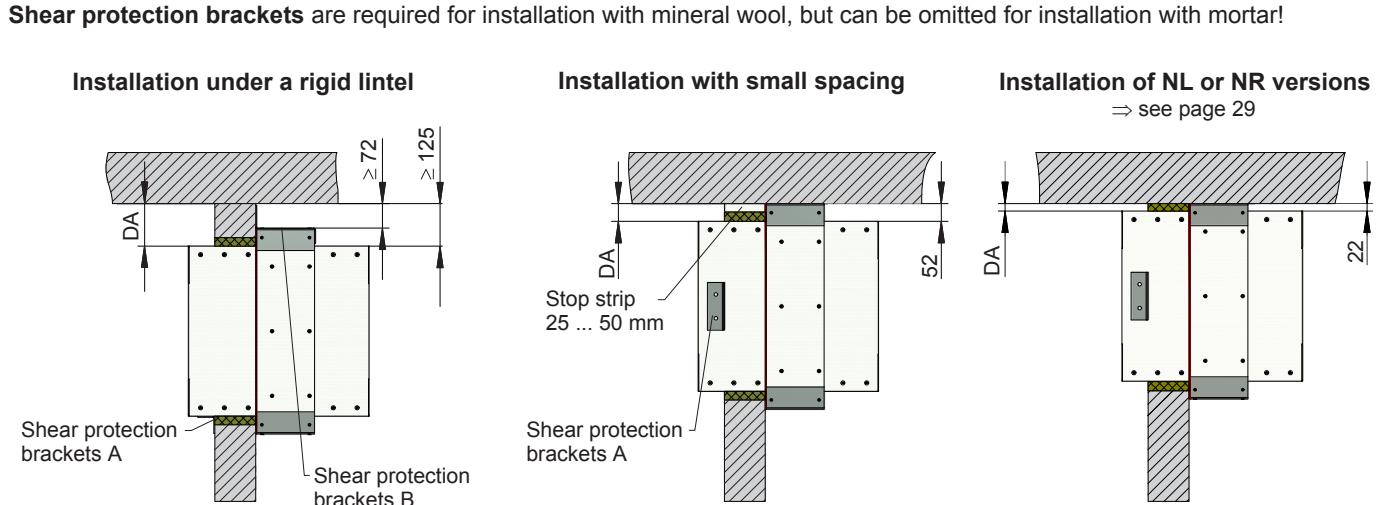

- Spacing $DA \geq 180$ mm:
Shear protection brackets A and B can also be used above, below and laterally; and combined as A and B.
⇒ see page 19
- Spacing $DA \geq 125$ mm up to ≤ 180 mm:
Shear protection brackets A can be used laterally, and shear protection brackets B above and below.
- Spacing $DA \geq 52$ mm up to ≤ 125 mm:
Shear protection brackets A or B can be used laterally.
Depending on the spacing DA, thick filling strips from 25 to 75 mm, made from calcium silicate boards, are required with approx. ≥ 500 kg/m³ bulk thickness.
They should be fastened to the ceiling with screws or bolts with a diameter of 5 mm or more.
- Spacing $DA = 22$ mm:
Shear protection brackets A or B can be used laterally.

All dimensions in mm


EK90 smoke control dampers

Installation in flexible walls (1) Metal stud walls, including fire walls


Installation in flexible walls in the form of metal stud walls with cladding on both sides and a thickness from 95 mm and stud spacing up to 1000 mm is performed as dry installation.

EK90 smoke control dampers are used in circumferential frames made from wall profiles, in accordance with the thickness of the wall. The frames must be connected and fixed to the studding.

Installation can be performed in a horizontal or vertical axis position. ⇒ see page 33

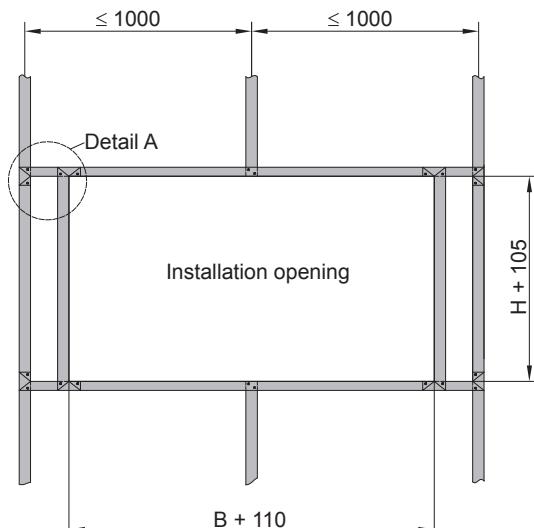

Example of an **installation opening** in metal studs
 $b \times h = (B + 110 \text{ mm}) \times (H + 105 \text{ mm})$

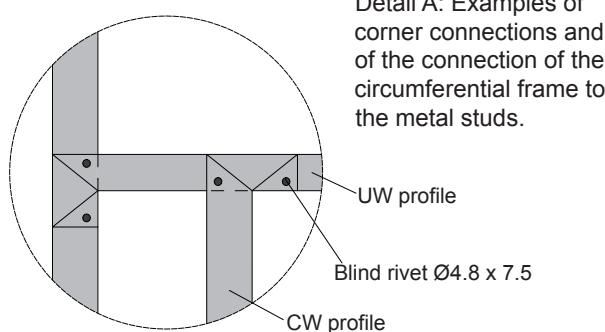



Shear protection strips must be produced on site using calcium silicate boards with approximately $\geq 500 \text{ kg/m}^3$. Cuts of $\geq 50 \text{ mm}$ width and 35 mm height are suitable. They must be glued on circumferentially around the non-operation side (rear) of the smoke control damper and screwed down at spacings of $\leq 200 \text{ mm}$. Where access is limited under ceilings or on walls, strips must be attached on at least the two opposing horizontal or vertical sides!

For the length L of the smoke control dampers, excess lengths of $Z \geq 70 \text{ mm}$ are required to fit the strips, or excess lengths of $Z \geq 100 \text{ mm}$ if smoke extraction ducts with fire resistance period are being connected.

⇒ see page 4

Installation in flexible walls must be implemented with shear protection strips! The shear protection brackets A and B cannot be used for this type of installation!

In metal stud walls in the form of **fire walls**, stud profiles should be used with a 2 mm wall profile (UA profile), either directly on either side of the smoke control dampers or in the area of the smoke control dampers, depending on the structural constraints.

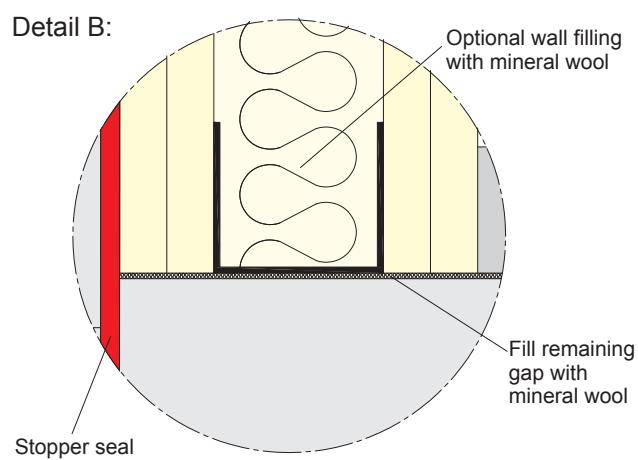
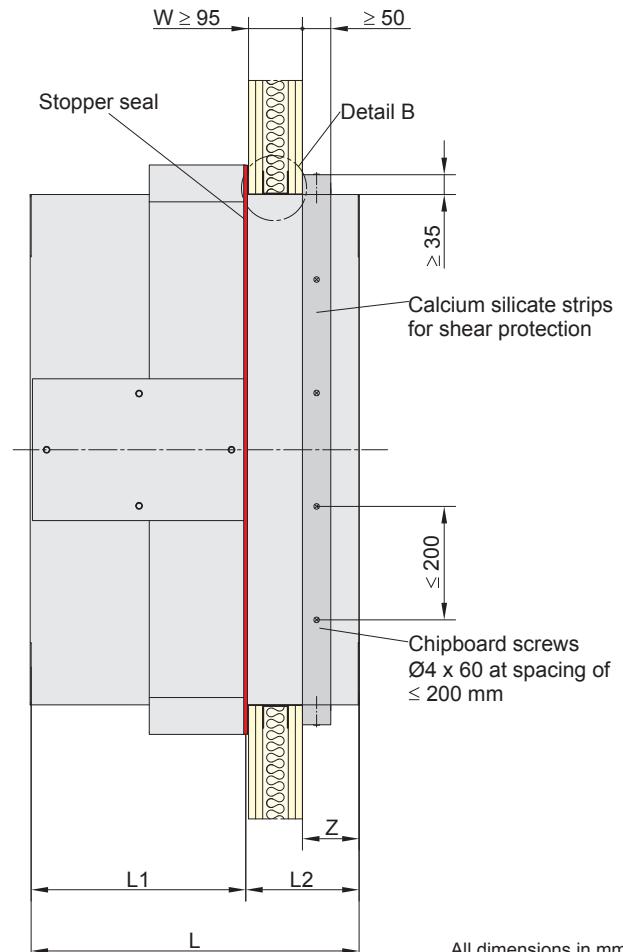


The wall can be filled with mineral wool $\leq 100 \text{ kg/m}^3$.

EK90 smoke control dampers

Installation in flexible walls (2) Metal stud walls



EK90 smoke control dampers either directly next to or on top of one another **in metal stud walls** with cladding on both sides.

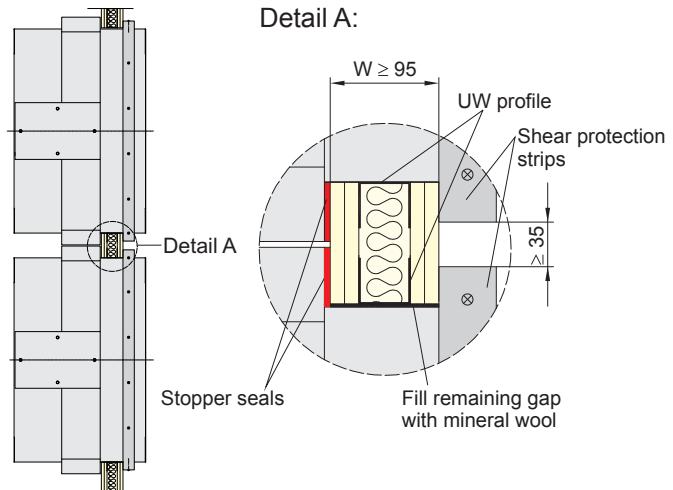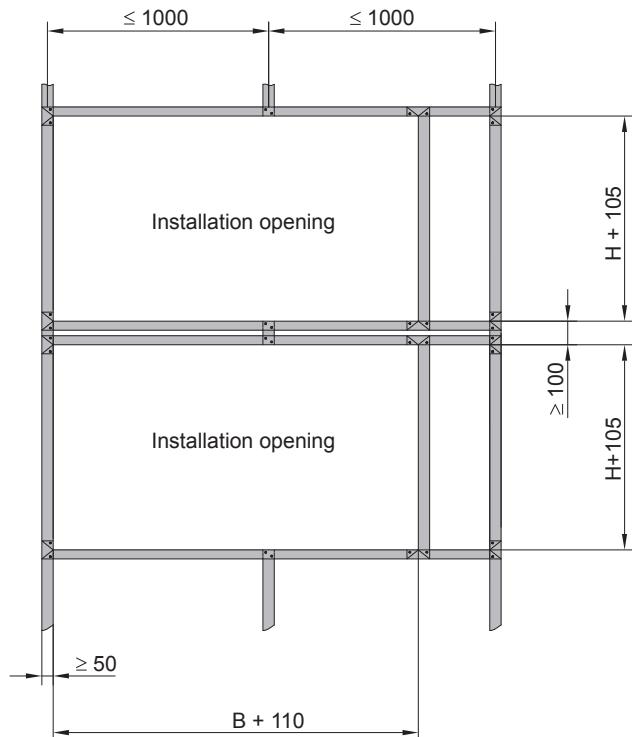


Example: Installation of two EK90 smoke control dampers directly on top of one another.

Installation of the dampers directly underneath one another is performed in the same way.

EK90 smoke control dampers in metal stud walls with cladding on both sides, directly adjoining rigid walls and ceilings.

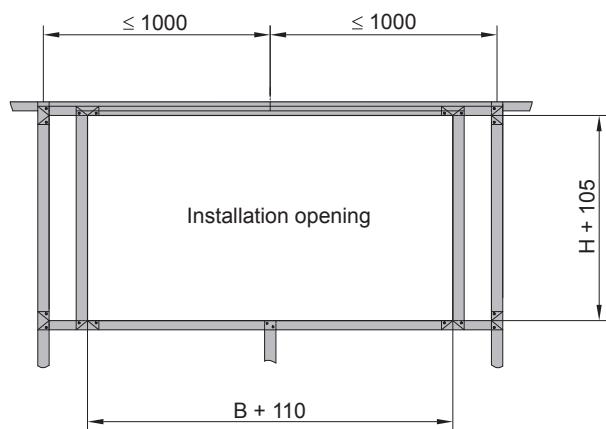

Detail B:

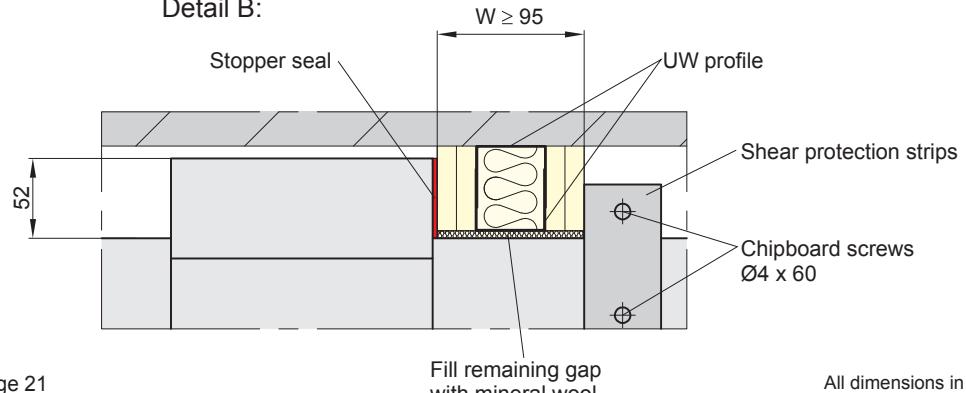

The 52 mm spacing can be reduced to 22 mm when using the NL or NR versions!
⇒ see pages 29 and 34.

Shear protection strips ⇒ see page 21


Fill remaining gap with mineral wool

All dimensions in mm


EK90 smoke control dampers

Installation between smoke extraction ducts and connections


Connecting smoke extraction ducts made of wall boards with fire resistance period

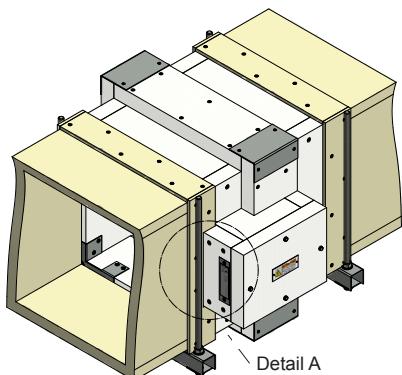


Connect the smoke extraction duct without filling strips.

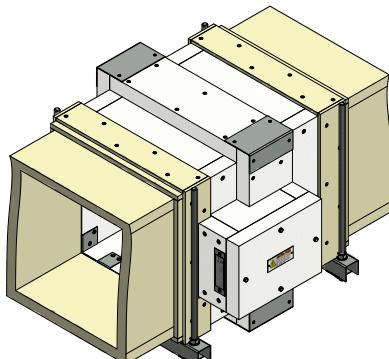


Connect the smoke extraction duct with filling strips made from duct-specific materials.

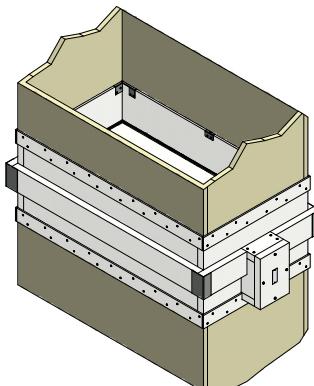

Connect vertical smoke extraction ducts as shown, with or without filling strips made from duct-specific materials.

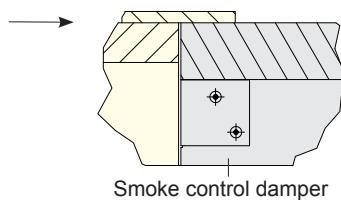


Smoke control damper

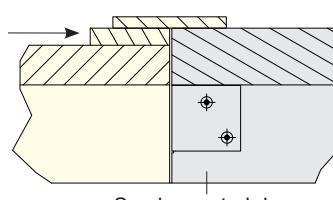

Smoke control damper

Detail A
Notching the
flashing strip in
the area of the
motor cover






For information on the suspension or attachment of the smoke control dampers ⇒ see page 28


Connecting the sheet steel smoke extraction duct and protective grille

Example

Left-hand-side smoke extraction duct made from sheet steel, right-hand-side smoke extraction duct made from wall boards (with fire resistance period).

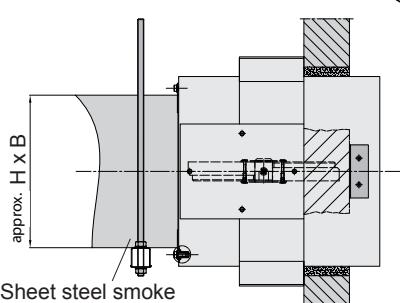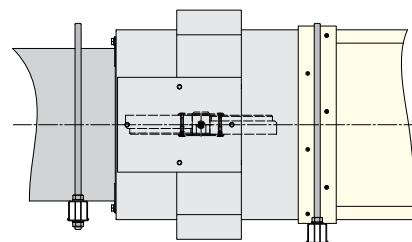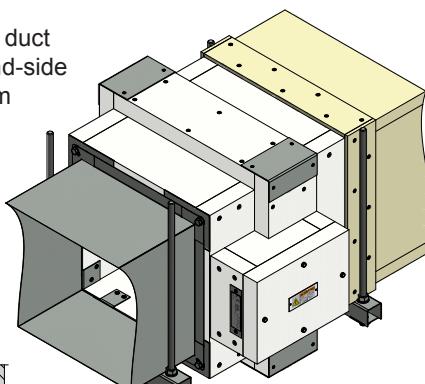


Sheet steel smoke extraction duct

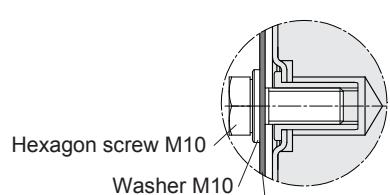

Hexagon screw M10
Washer M10

Connection flange for smoke extraction duct



Protective grille
M10

- The connection flanges of the smoke extraction ducts and protective grilles can be screwed directly onto the smoke control dampers.
- The freedom of movement of the damper blade should be taken into account when mounting the protective grilles.
⇒ see damper blade excess length on page 4

Extensions in the form of smoke extraction ducts made from sheet steel should be used as required.

All dimensions in mm

EK90 smoke control dampers

Lateral mounting on smoke extraction ducts (1)


EK90 smoke control dampers can be fitted to the side of smoke extraction ducts with fire resistance period and a wall thickness of ≥ 35 mm.

The EK90 smoke control dampers can be mounted in a horizontal or vertical axis position. ⇒ see page 33


The damper blade should ideally be positioned parallel to the direction of flow or outside of the flow, so as to avoid any interfering forces.

The smoke extraction ducts can be aligned horizontally or vertically, and must be designed and fitted in accordance with the manufacturer's specifications.


The screw sizes specified in the following drawings relate to smoke extraction ducts with a thickness of 35 mm. The screw lengths should be adapted in the case of greater thicknesses.

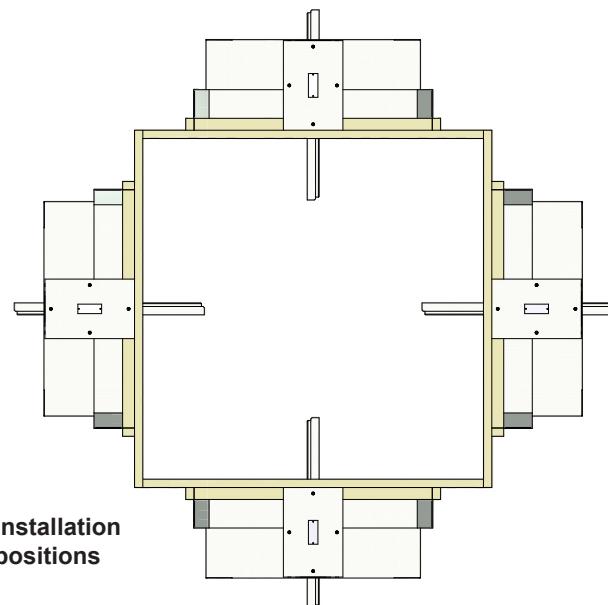


Mounting on smoke extraction ducts with clear widths $\geq H_{\text{smoke control damper}} + 300$ mm

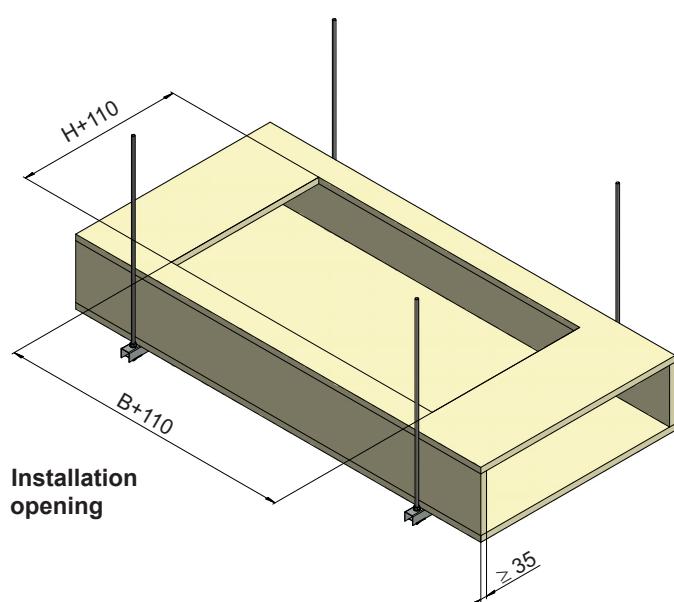

Installation opening

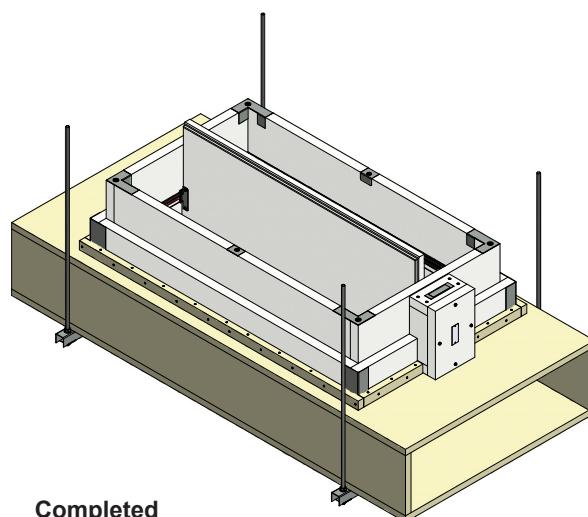


Completed installation

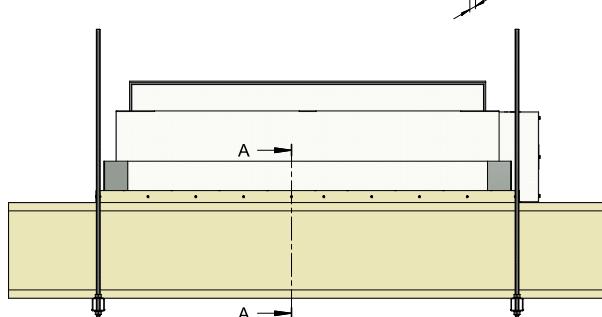

Longitudinal view

Strips must be produced from duct-specific materials, glued to the smoke extraction duct and screwed on using chipboard screws with a diameter of 4 x 80 at spacings of ≤ 200 mm. The smoke control dampers must be screwed on in the same way, but using chipboard screws with a diameter of 4 x ≥ 60 .

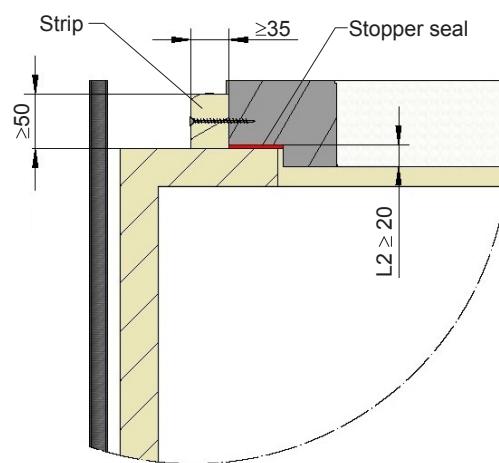


All dimensions in mm

EK90 smoke control dampers

Lateral mounting on smoke extraction ducts (2)

Mounting on smoke extraction ducts with clear widths $\geq H_{\text{smoke control damper}} + 300 \text{ mm}$. This installation version allows for mounting at a maximum offset of 70 mm. Flashing strips are then used for assembly.

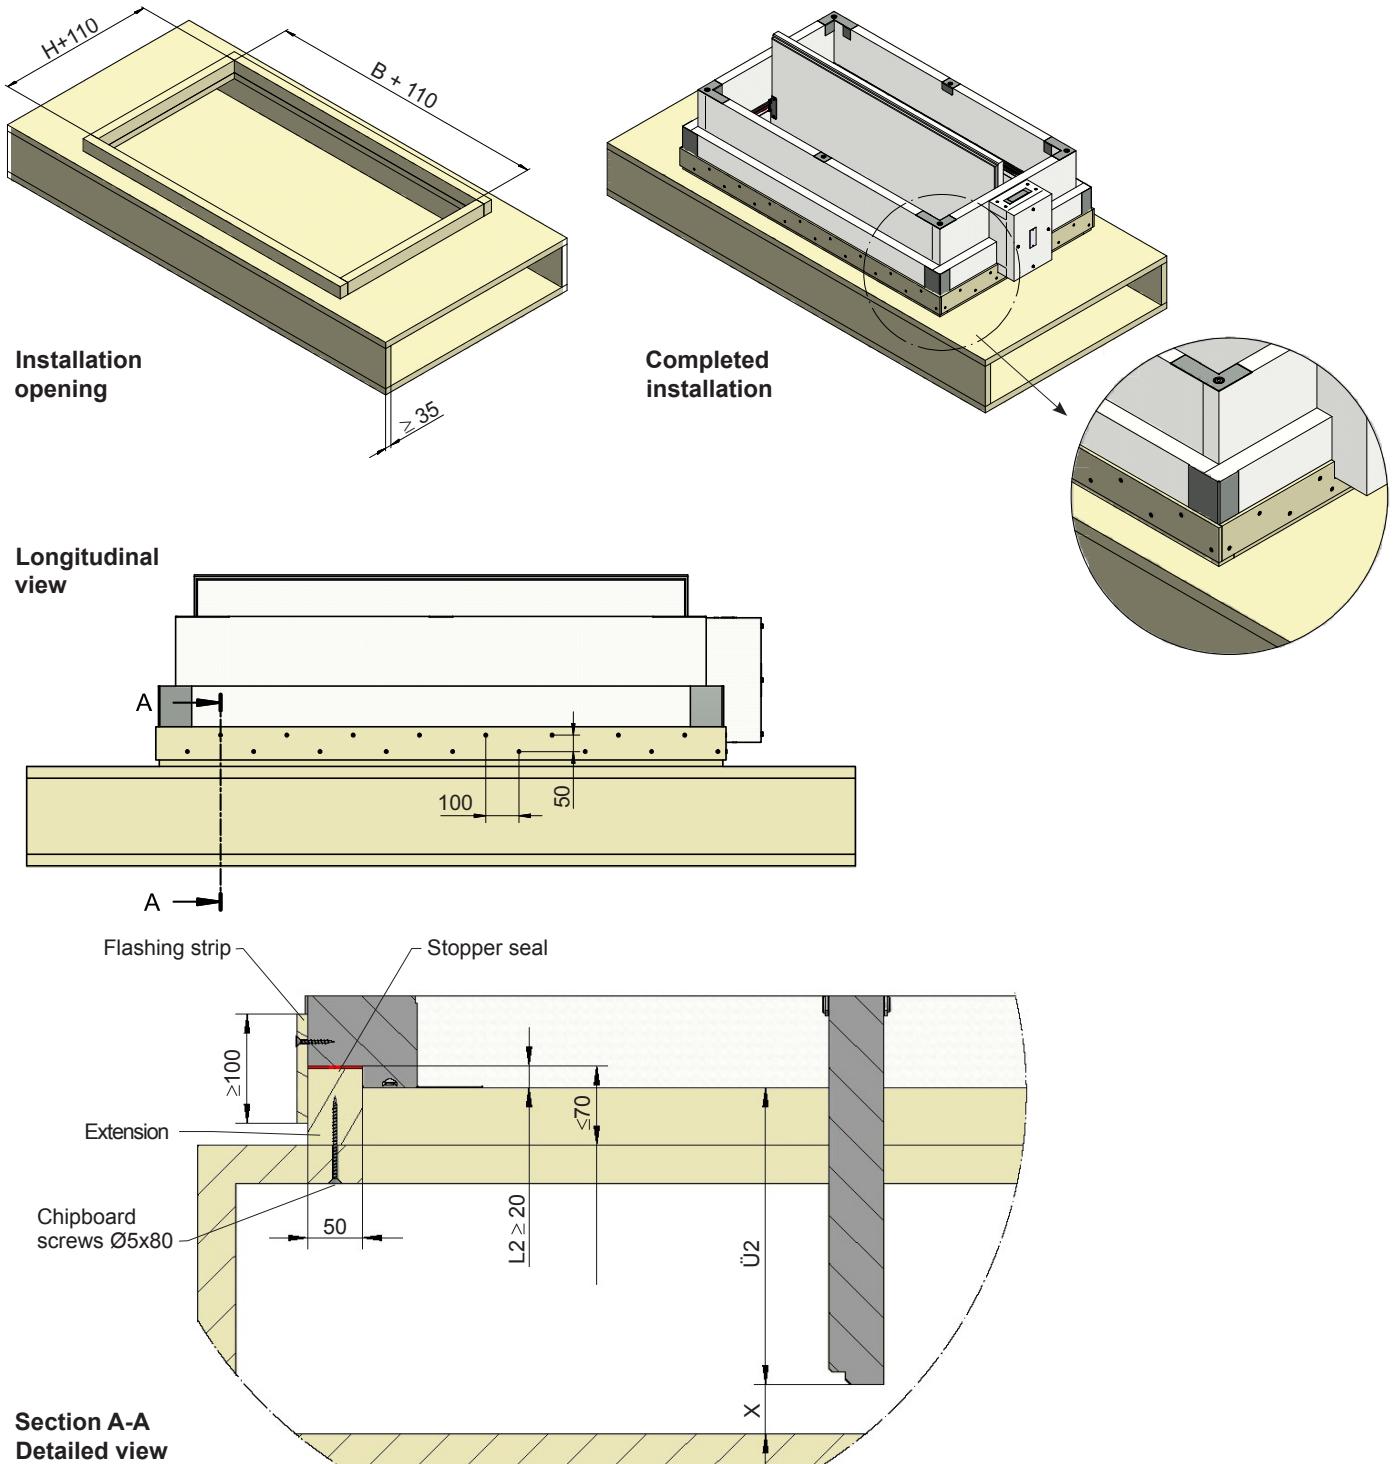

Damper blade excess length $\ddot{U}2 \Rightarrow$ see page 4

Spacings of $x \geq 20 \text{ mm}$ must remain between the opened damper blade and the casing wall.

Extensions must be produced from duct-specific materials in the cross-section $50 \text{ mm} \times \leq 70 \text{ mm}$, glued to the smoke extraction duct and screwed on using chipboard screws with a diameter of 5×80 at spacings of $\leq 160 \text{ mm}$.







Flashing strips must be produced from duct-specific materials, glued to the smoke extraction duct and the smoke control damper, and screwed on using chipboard screws with a diameter of 4×80 at spacings of $\leq 200 \text{ mm}$.

All dimensions in mm

EK90 smoke control dampers

Lateral mounting on smoke extraction ducts (3)

Mounting on smoke extraction ducts with clear widths $\geq H_{\text{smoke control damper}} + 130 \text{ mm}$

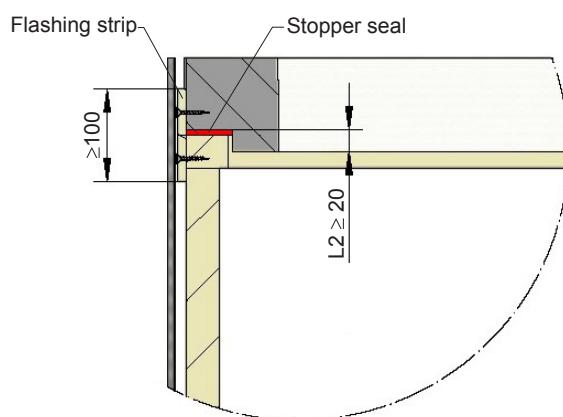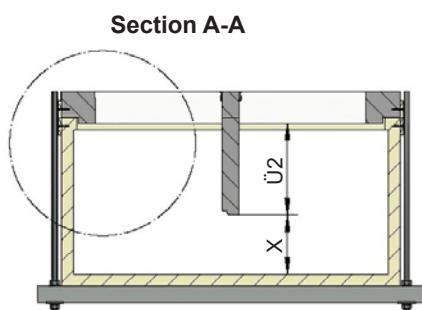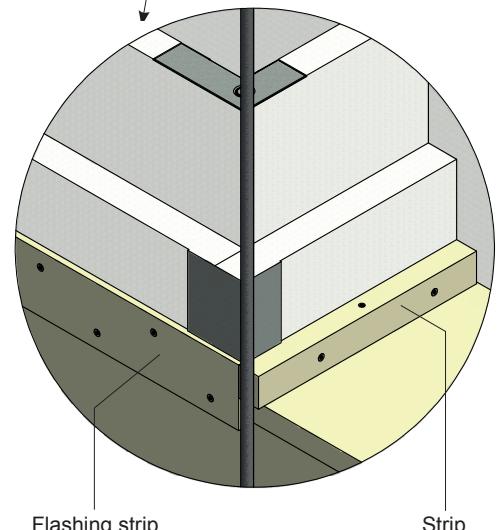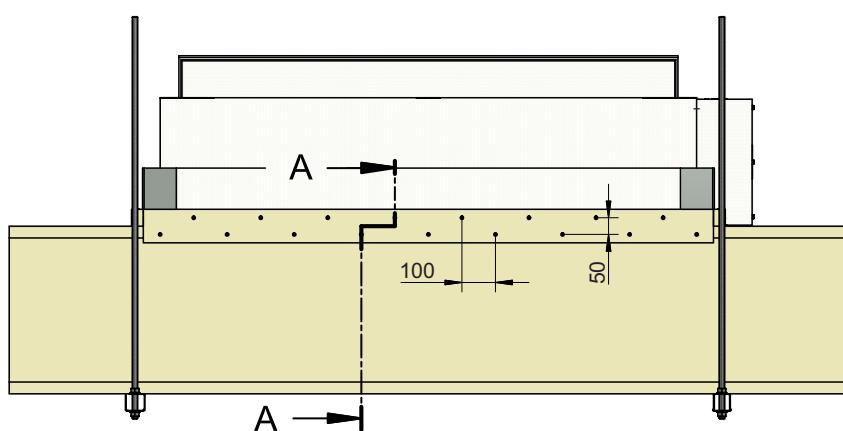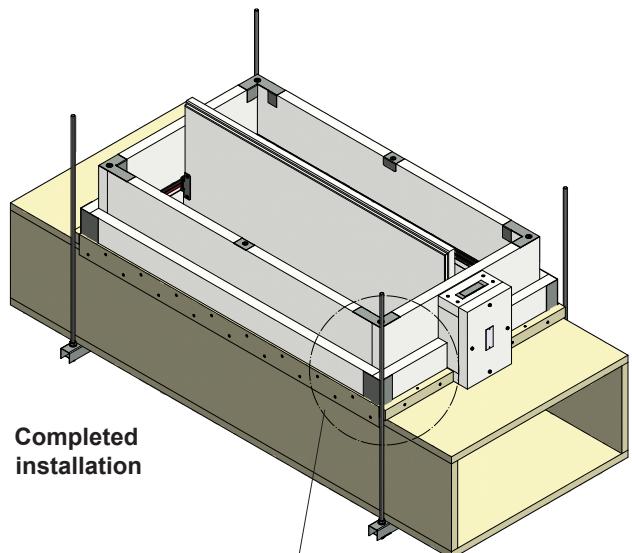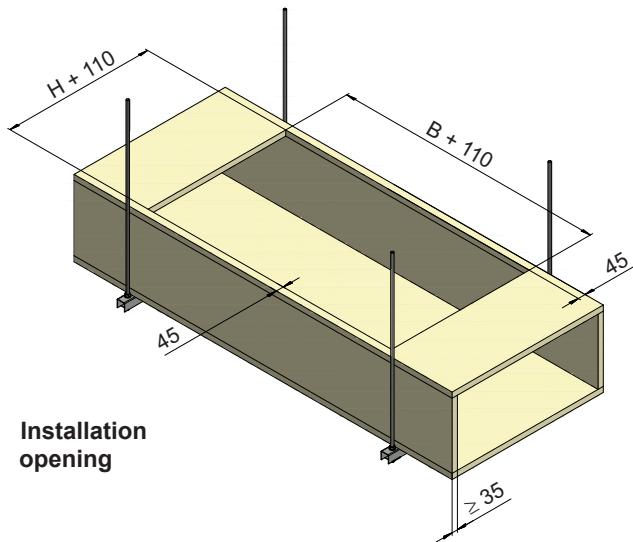


Damper blade excess length $\ddot{U}2 \Rightarrow$ see page 4
Spacings of $x \geq 20 \text{ mm}$ must remain between the opened damper blade and the casing wall.

All dimensions in mm

EK90 smoke control dampers


Lateral mounting on smoke extraction ducts (4)

Mounting on vertical smoke extraction ducts

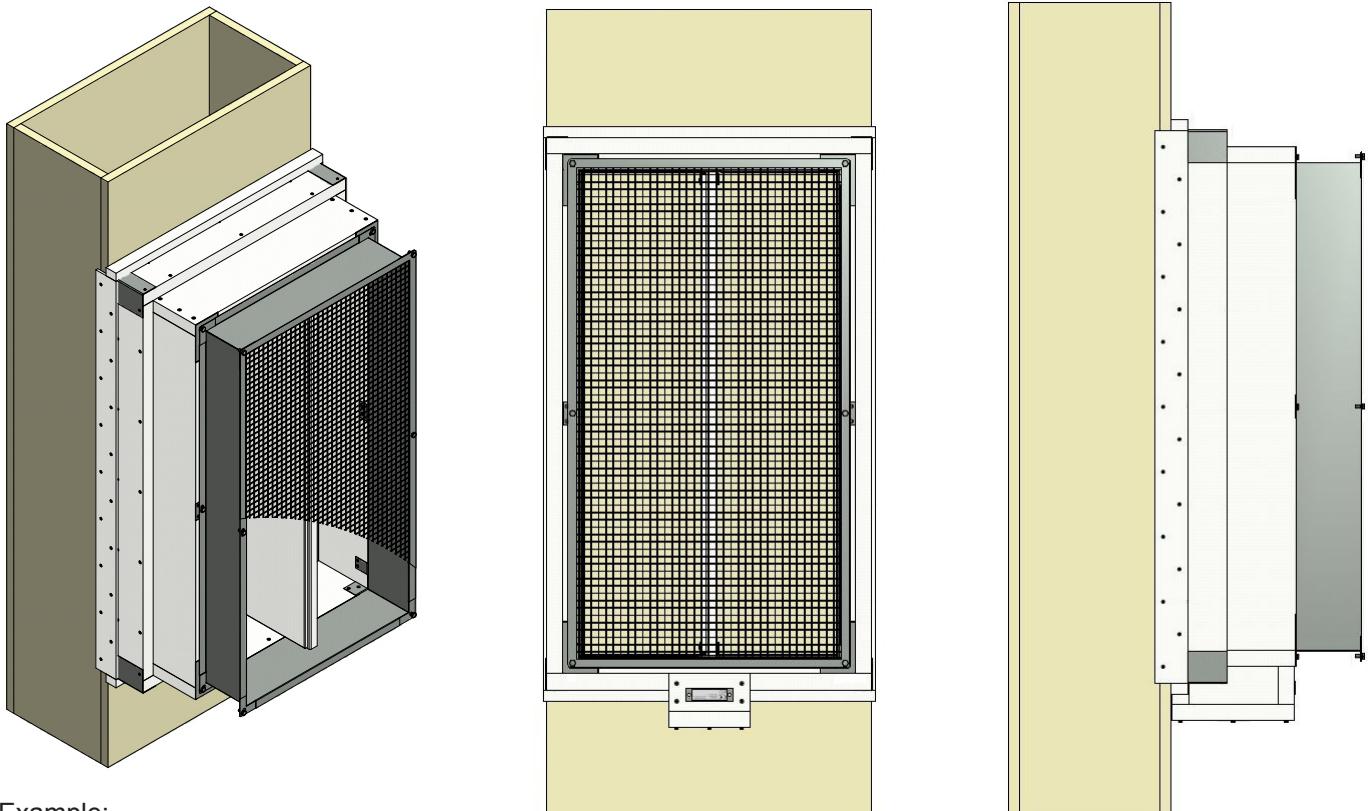

Example:

Smoke control damper with protective grille

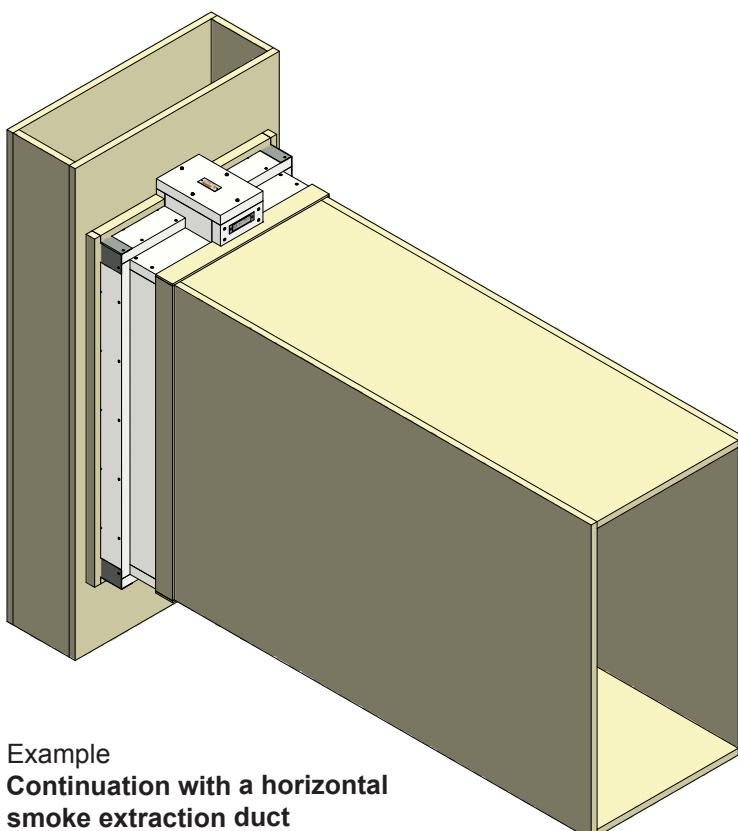

Example

Continuation with a horizontal smoke extraction duct

- Smoke control dampers must be connected to vertical smoke extraction ducts in the same way as to horizontal ducts!
⇒ see pages 23 to 26
 - For information on the suspension or attachment of the smoke control dampers
⇒ see page 28
 - The freedom of movement of the damper blade should be taken into account when mounting the protective grilles.
⇒ see damper blade excess length on page 4
- Extensions in the form of smoke extraction ducts made from sheet steel should be used as required.

All dimensions in mm

EK90 smoke control dampers


Fire-resistant suspensions and attachments

Dimensioning of beams in accordance with DIN 4102-4

Maximum permissible weights G on suspensions with steel threaded rods with a fire resistance period of 90 to 120 minutes:


| Size | A_s [mm ²] | Weight load G [kg] | |
|------|-----------------------------|--------------------|------------|
| | | For 1 unit | For 1 pair |
| M8 | 36.6 | 22 | 44 |
| M10 | 58.0 | 35 | 70 |
| M12 | 84.3 | 52 | 104 |
| M14 | 115 | 70 | 140 |
| M16 | 157 | 96 | 192 |
| M18 | 192 | 117 | 234 |
| M20 | 245 | 150 | 300 |

A_s : Tensile stress cross-section according to DIN 13



- Beams must fit tightly against the walls of the smoke extraction ducts or on the casing of the smoke control dampers. Otherwise, they will need to be clad. This also applies to beams that are larger than 1.5 m in length.
- Traverses should be at least U50 according to DIN 1026.
- Shims should be used as required.

Attachment of beams in rigid ceilings

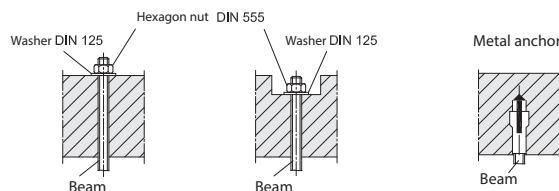


Dowels must be suitable and approved for fire protection, and installed accordingly.

Example:

Suspension of an EK90 smoke control damper together with connected smoke extraction ducts.

Weights of EK90 smoke control dampers ⇒ see page 17

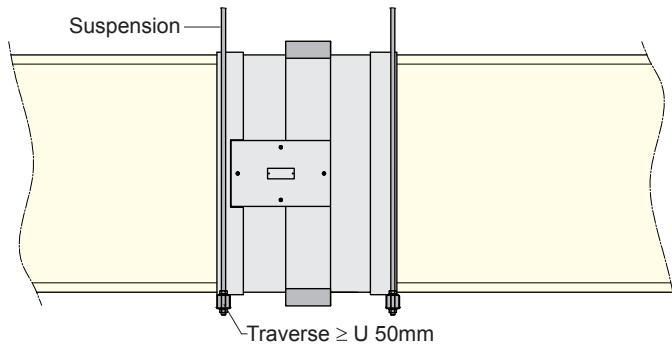

Attach shear protection brackets B with dowels.

⇒ see page 19

Plugs are required for a fire resistance period of 90 minutes.

The following can be used for the various materials:

- **Concrete:**

Fischer bolt anchor FAZ - II 8

- **Aerated concrete:**

Fischer anchor M8 FPX - I

- **Concrete, aerated concrete, masonry:**

Fischer injection mortar systems FIS V, VW, VS together with the anchor rods FIS A - M8



Shims should be used if required.

Example

EK90 smoke control dampers between vertical smoke extraction ducts are generally supported by the lower sections of the smoke extraction duct.

Fastenings for the smoke control dampers must therefore match the fastenings for the smoke extraction ducts.

The specifications of the smoke extraction duct manufacturer must be observed.

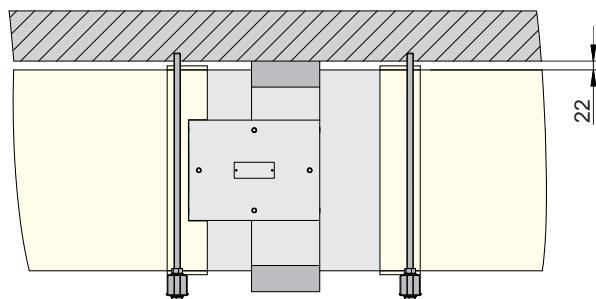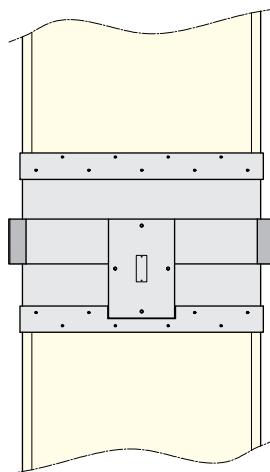

Example

EK90 smoke control dampers in versions NL or NR directly underneath ceilings. ⇒ see page 29


The specifications of the smoke extraction duct manufacturer must be observed.

EK90 smoke control dampers

Option: NL and NR versions for reducing spacing underneath rigid ceilings


NL Version

Motor drive on the left



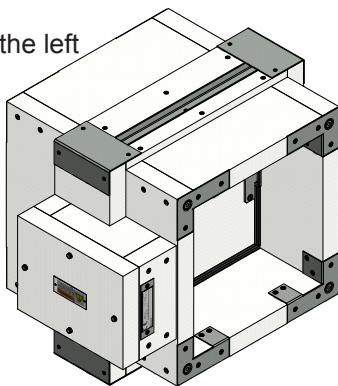


NR Version

Motor drive on the right

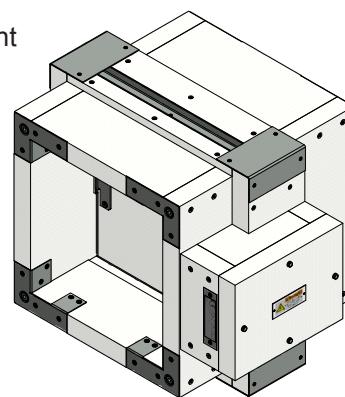


Installation in rigid walls

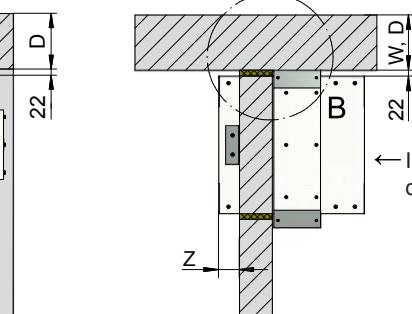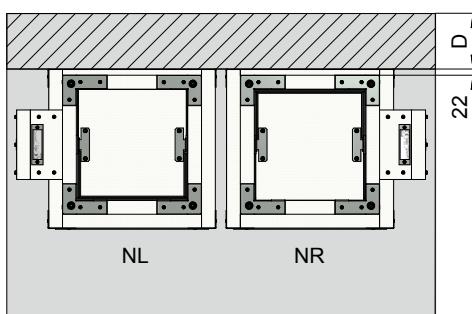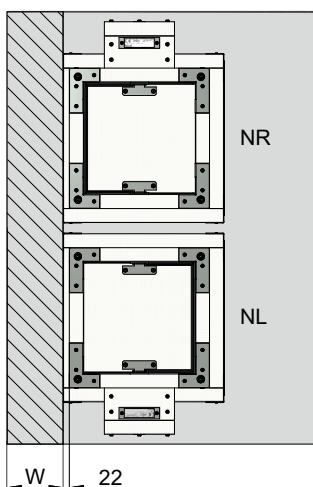


View of the operation side (in direction of installation)

Details for installation and
shear protection brackets
⇒ see pages 18 to 20

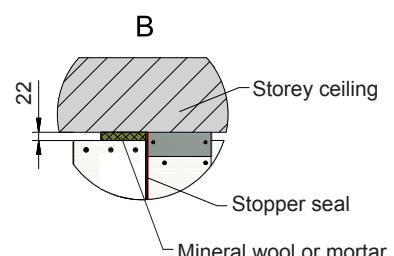


When damper blades are positioned vertically, versions NL and NR can also be positioned vertically on a solid wall.

Installation in metal stud walls

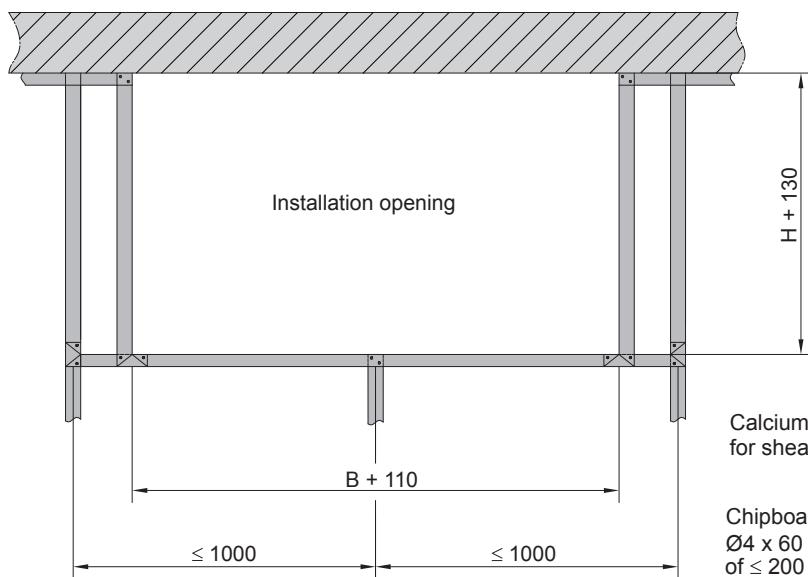

Details for installation and strips for shear protection
⇒ see pages 18 to 20

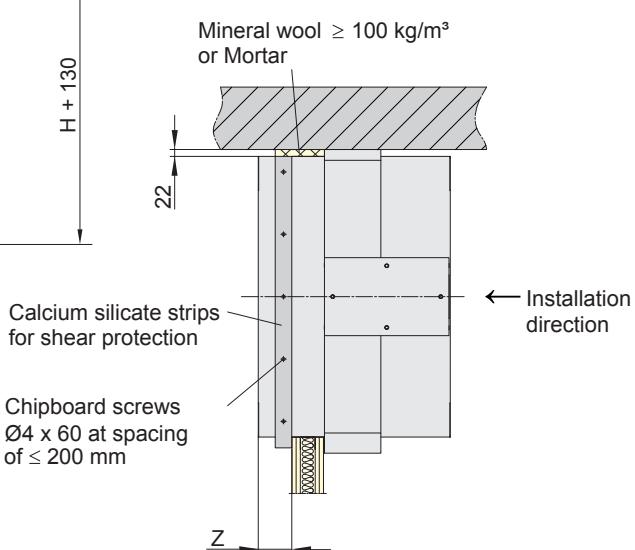

EK90 smoke control dampers

Electrical connection (1) motor drives

The **electric drive** is located to the side of the smoke control damper, inside the calcium silicate **casing**.


The motor drive can be accessed by unscrewing the casing cover. Electrical cables should be guided through the walls of the casing for the motor drive on site.

Holes should be arranged for these as shown and matched to the diameter of the cables.


Depending on the height H of the smoke control damper, motor drives with difference performance data can be fitted:

| Motor drive | M1 24 V AC/DC | M2 230 V AC |
|--|------------------|----------------|
| Standard design | | |
| Height H ≤ 450 mm | 7.5 W / 9 VA | 5 W / 12 VA |
| Height H > 450 mm | 12 W / 18 VA | 8 W / 15 VA |
| Special design of electrical connection | 12 W / 18 VA | 8 W / 15 VA |
| Protection class IP54, runtime: ≤ 60s | | |


Motor drives for EK90 smoke control dampers,
shown with the optional terminal strip for easy electrical connection.

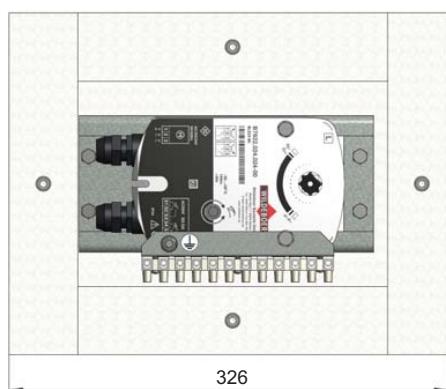

Motor drive for standard design with heights H = 200 to 450 mm

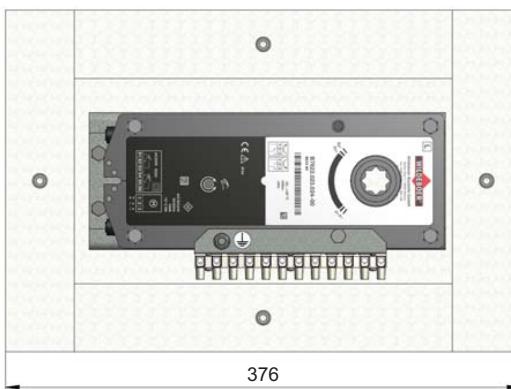


Motor drive for standard design with heights H > 450 up to 800 mm and for special design of electrical connection

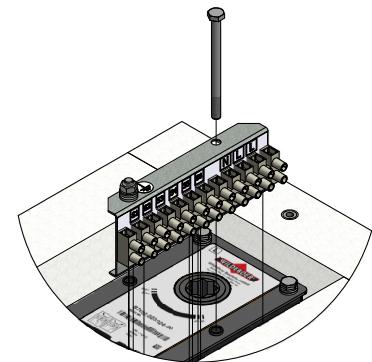


Option: terminal strip for electrical connection.

Electrical connection
Motor drives M1
24 V AC/DC




- 1 = Ground neutral
- 2 = Rotation direction "OPEN"
- 3 = Rotation direction "CLOSED"

Electrical connection
Motor drives M2
230 V AC





Limit switch assignment S1 to S6

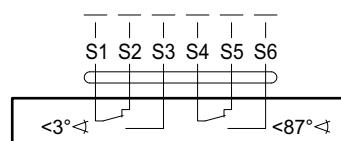

Schematic circuit diagram:
Limit switch for "CLOSED position" actuated in < 3° angle position, smoke control damper is in "CLOSED position".

- The limit switch for the "CLOSED position" (S1 contact with S2) of the smoke control damper is actuated at angle position < 3°.
- The limit switch for the "OPEN position" (S4 contact with S6) of the smoke control damper is actuated at angle position ≥ 87°.
- The intermediate position is signalled in angle position > 3° and < 87° (S1 contact with S3 and S4 contact with S5).




Configuration of AMP connectors on motor drives 24 V AC/DC

Casing for the motor drive

Recommended **hole positions** for inserting the electrical **cables** are labelled at the factory.

Required holes should be produced as required on site.



Hole diameter = cable diameter

Additional casing for control units ⇒ see page 32

EK90 smoke control dampers

Electrical connection (2) Notes for electrical installation and power supply

Notes for electrical installation

- Smoke control dampers should also be able to open and close when exposed to fire.
- For this reason, an electrical power supply functions in the event of fire and has suitable connection cables up to the smoke control dampers is a requirement.

Electrical cables, class E90, with functional integrity of 90 minutes should be used. The minimum requirement is functional integrity of 30 minutes and classification E30.

However, the classification tests relate only to short-circuit resistance and power failure in the event of fire though.

- The electrical resistance in the connection cable increases when exposed to fire because of the increased temperature; up to 2.6-fold after 30 minutes and up to 4.6-fold after 90 minutes. As a result, the electrical voltage drop increases while the remaining voltage on the motor drives falls.

When dimensioning the connection cables, this should be factored in with large cross-sections, shorter lengths or a higher electrical operating voltage accordingly.

The same applies to connection cables for operating voltages with multiplexed data transmission; for example, AS-i and other BUS systems.

Otherwise, smoke control dampers could not open or close as they are supposed to in the event of fire.

- Correct dimensioning of the connection cables and operational safety of data transmission cannot be stressed enough! Likewise, attention must be paid to the prescribed type of laying and installation for electrical cables and their functional integrity!
- It is generally recommended that smoke control dampers be used for 230 V AC and connected via E90 cables with 1.5-mm² conductor cross-section.

The length of said E90 cables can be 250 m or more. Otherwise, only short connection cables may be possible.

Additional switching equipment should be installed in a fireproof room or switch cabinet.

Power supply




- Mechanical **systems for smoke extraction** require a reliable power supply in the event of fire. A power supply, as provided by power generation equipment (backup power), in addition to the public power grid conforms to requirements under public law.

EK90 smoke control dampers

Electrical connection (3) Option: Additional casing for control units

An additional casing for the extra control units can be installed between the motor drive casing and its removable cover. The connection cables of the motor drive can be guided into this and connected to the control unit or the additional electrical cables.

Holes for cables drawn through the walls of the extra casings can be produced on site.

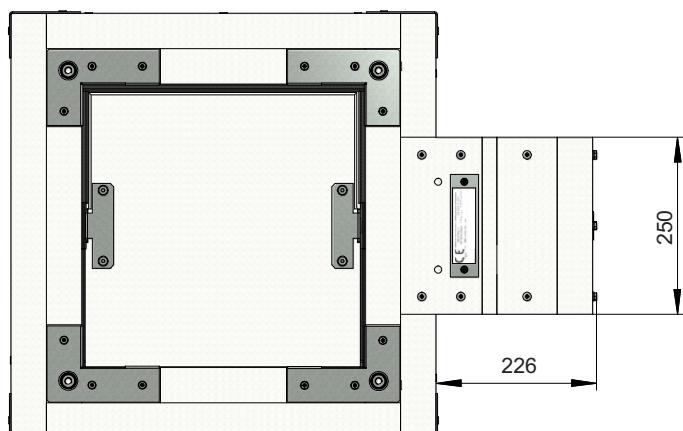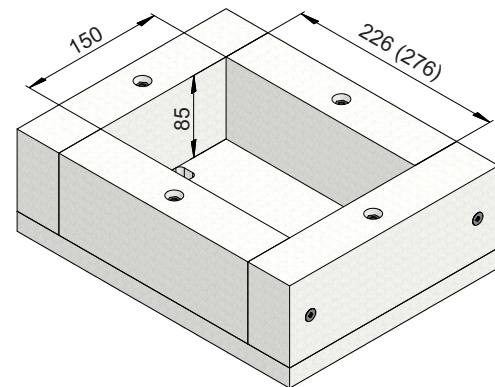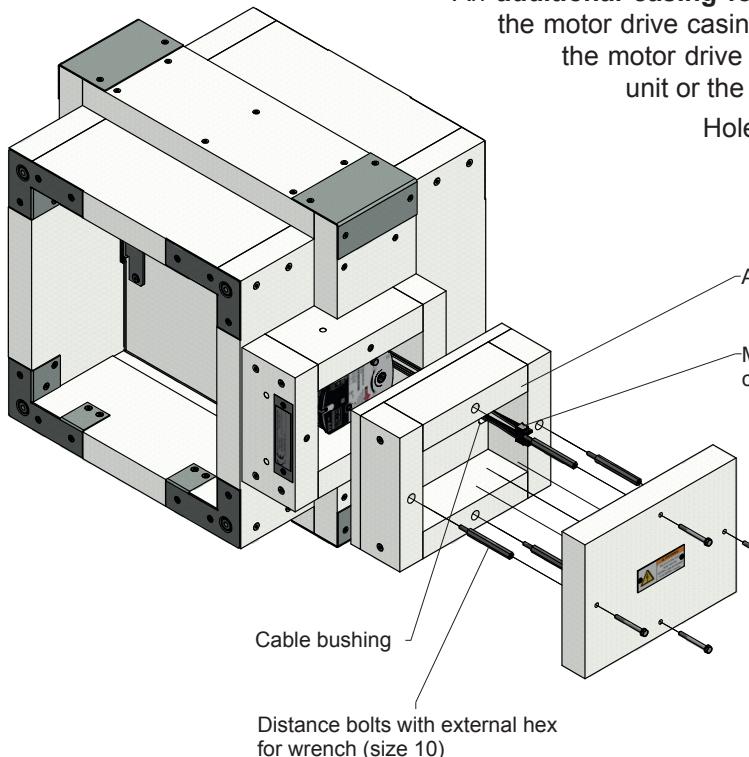

The clear dimension of the additional casing depends on the type of EK90 smoke control damper:

| Design | Heights H [mm] | Clear dimension [mm] |
|---|----------------|----------------------|
| Standard design | H ≤ 450 | 226 |
| | H > 450 | 276 |
| Special design of electrical connection | all | 276 |

These additional casings can also be retrofitted on site on request! They should then be ordered with either dimension 226 or 276!

On request: Designs different to clear dimension = 85 mm.

Please observe notes for the laying and dimensioning of cables!

⇒ see page 31

EK90 smoke control dampers

Function in smoke extraction systems - installation - functional testing/servicing

Function of smoke extraction systems with EK90 smoke control damper, Series EK92

- EK90 smoke control dampers, Series EK92, are suitable for smoke extraction systems and for combined systems for smoke extraction and building ventilation. They supersede the former EK90 smoke control dampers in accordance with approval Z-78.2-7 and EK90 smoke control dampers with ventilation function in accordance with approval Z-78.3-104.
- EK90 smoke control dampers, series EK92, in **systems only for smoke extraction** are usually closed. In the event of fire, all of them or only those required can be opened from the outset. As the fire develops and smoke is released, other ones can be opened and the previously opened ones can be closed again.
- EK90 smoke control dampers, Series EK92, required

for building ventilation in **combined systems for smoke extraction and building ventilation** are usually opened, whereas others are closed.

In the event of fire, the smoke control dampers required for smoke extraction are opened or are kept open, while others are closed or remain closed.

- As the fire develops and smoke is released, other EK90 smoke control dampers, series EK92, can be opened and previously opened ones can also be closed. The function with HOT classification is verified.
- EK90 smoke control dampers, series EK92, can still be opened 25 minutes after the onset of full fire exposure. The function with MA classification is verified.


Installation

- **EK90 smoke control dampers, series EK92, must be installed and operated in accordance with this user manual and in compliance with all other regulations.**

In addition, smoke control dampers must be installed tension-free and appropriately aligned.

Air flows in the smoke extraction ducts must not adversely affect the torques acting on the damper blade by the motor.

Installation can be performed in a horizontal or vertical axis position.

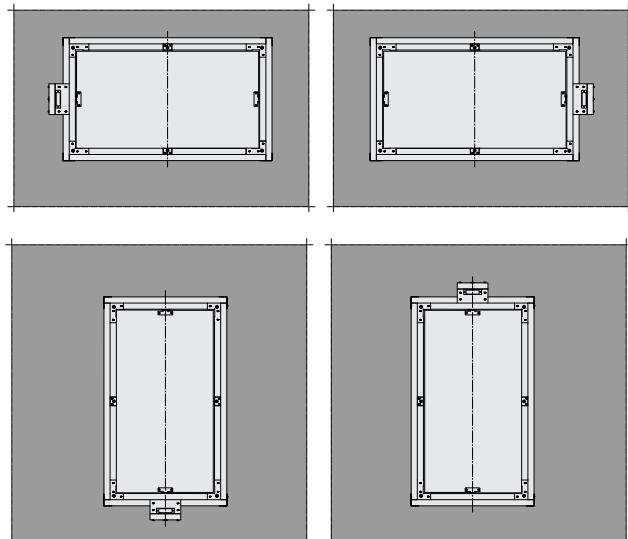

Casings should be installed in installation openings in walls such that they lie largely flush on the bottom side. If remaining gaps are filled with mineral wool, a melting point of $\geq 1000^{\circ}\text{C}$ must be verified for this. Shear protection brackets should be installed accordingly.

Structural requirements and concerns, as well as relevant manufacturer's specifications, should be verified and observed by the customer.

- Smoke control dampers for outside air supply must be installed such that heavy moisture penetration is avoided, in particular in the event of frost exposure.
- Assembly, electrical wiring, connections etc. must be produced on site.
- Smoke extraction ducts and electrical equipment must be suitable, and must be correctly installed and connected.
- Inspection openings must be provided on site in the smoke extraction ducts if necessary.

Functional testing/servicing

- In accordance with German regulations, smoke extraction systems must be serviced and kept ready for operation by the owner. The smoke control dampers must be tested for correct functioning at six-month intervals. If successive tests are passed without any defects, the next test may be carried out after one year.

- **Operating instructions** for the EK90 smoke control dampers, Series EK92, are available on the Internet at www.wildeboer.de.

In general, actuating (closing and opening) the smoke control dampers is sufficient in testing the function. This can be performed by means of remote actuation.

EK90 smoke control dampers do not generally require any maintenance work.


The cleaning of smoke extraction systems should be performed in an operation-dependent manner, and also includes the smoke control dampers.

Repairs or service work are required in the event of malfunctions.

Original spare parts must be used.

EK90 smoke control dampers

Order data

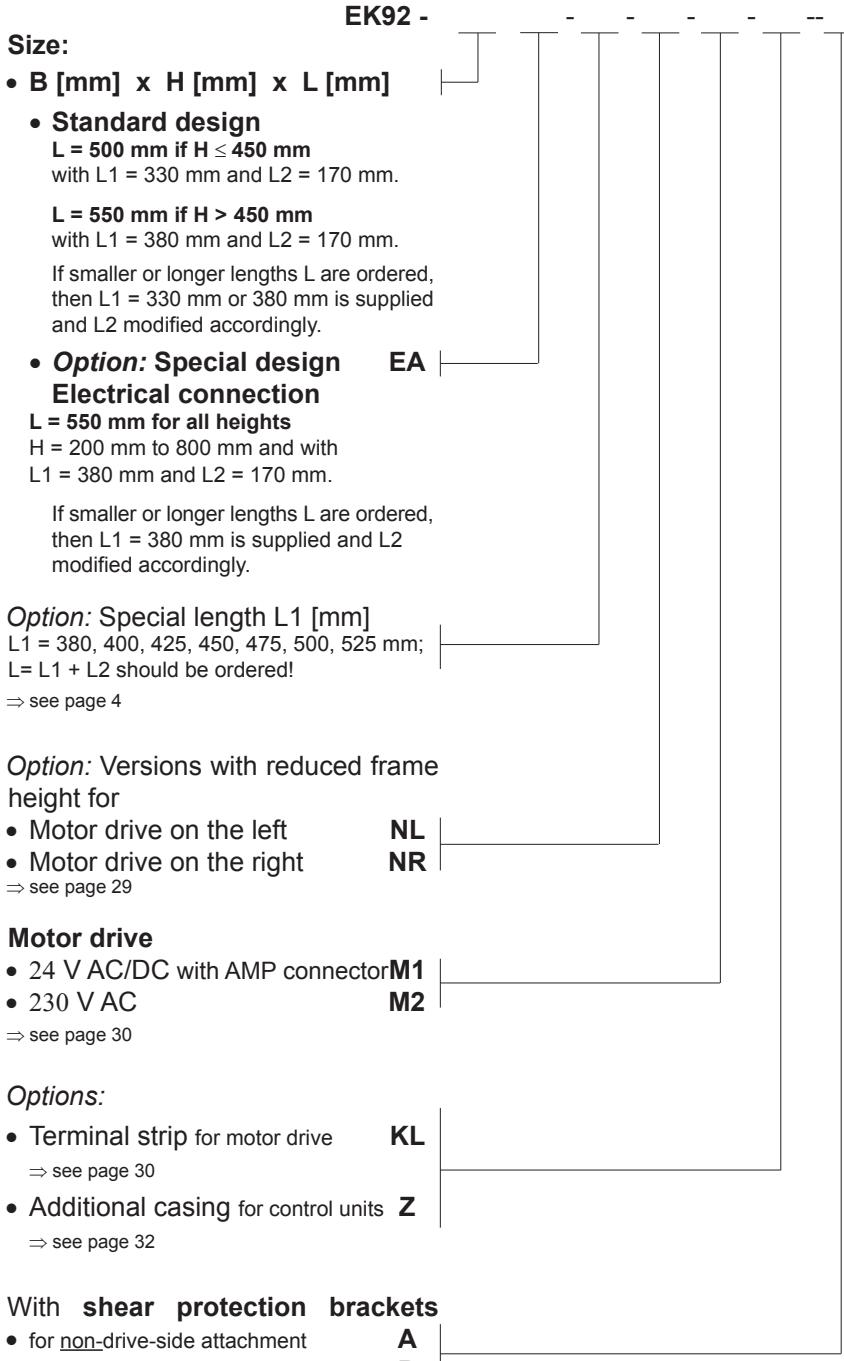

- Part of scope of delivery:**
- 2 x support bearings for gap width s = 25 mm
 - Stopper seal with adhesive
 - 1 set of shear protection brackets A or B, if specifically ordered.

Protective grille made from 1 mm galvanized sheet steel
with 20 mm mesh size and approx. 70% free cross-section.
Available dimensions: B x H ⇒ see pages 23 and 27

Available in **5 mm increments**:

- Clear widths **B** = 200 mm to 1500 mm
- Clear heights **H** = 200 mm to 800 mm
- **Lengths:**

| L = L1 + L2 | |
|--------------------|------------|
| $H \leq 450$ | $H > 450$ |
| 350 to 850 | 400 to 850 |

including

| L1 | |
|--------------|------------|
| $H \leq 450$ | $H > 450$ |
| 330 to 480 | 380 to 530 |

and

| L2 | |
|--------------|-----------|
| $H \leq 450$ | $H > 450$ |
| 20 to 370 | 20 to 320 |

- **lengths** Special design of electrical connection

The length L2 comprises the thickness of the wall W or ceiling D and the casting excess length Z. $L2 = W (D) + Z$
⇒ see pages 4, 18, 19, 20 and 21

Generally, shear protection brackets A with Z = 100 mm and strips for shear protection should be mounted on the casing of the smoke control dampers and all smoke extraction ducts should be connected at the same time.
⇒ For shorter "Z" dimensions, see page references above!

Lengths for double-sided mounting of protective grilles

Without excess lengths P1 and P2 ⇒ see page 4

| for heights H | Length L | Length L1 | Length L2 |
|---------------|----------|-----------|-----------|
| up to 400 mm: | 450 mm | 330 mm | 120 mm |
| up to 500 mm: | 550 mm | 380 mm | 170 mm |
| up to 550 mm: | 600 mm | 400 mm | 200 mm |
| up to 600 mm: | 650 mm | 425 mm | 225 mm |
| up to 650 mm: | 700 mm | 450 mm | 250 mm |
| up to 700 mm: | 750 mm | 475 mm | 275 mm |
| up to 750 mm: | 800 mm | 500 mm | 300 mm |
| up to 800 mm: | 850 mm | 525 mm | 325 mm |

All dimensions in mm

EK90 smoke control dampers

Specification text

Maintenance-free smoke control dampers according to EN 12101-8 for use in mechanical systems for smoke extraction, ventilation and air supply in single or multiple fire areas, fire compartments or rooms. Casing and damper blade made from abrasion-proof calcium silicate that is suitable for higher temperatures. With edge protection profiles, connection holes and stainless steel drive axles, and with electric motor drive for 24 V AC/DC or 230 V AC. With special seals to open and close the smoke control dampers during fire exposure. For installation in rigid walls and ceilings with mortar or mineral wool, in flexible walls and onto or between smoke extraction ducts.

..... Pc Width: mm
 Height: mm
 Length: mm
 Volume flow: m³/h
 Pressure drop: Pa
 Sound power level: dB(A)
 Fire classification:
 EI 90 (v_{edw} - h_{odw} - i ↔ o) S1500 C_{mod} HOT400/30 MA multi
 Environmental Product Declaration according to ISO 14025 and
 EN 15804
 Manufacturer: WILDEBOER
 Type: EK90, series EK92
 deliver:
 install:

Protective grille for smoke control dampers without connecting ducts for the protection of flow-through openings. Pressed with 20 mm mesh size made from 1 mm galvanized sheet steel.

..... Pc Width: mm
 Height: mm
 Manufacturer: WILDEBOER deliver:
 install:

INNOVATIVE · PRACTICAL · ECONOMICAL



Factory - Administration

Telephone: +49 (0)4951 - 950 - 0
Fax: +49 (0)4951 - 950 - 27120
E-mail: info@wildeboer.de
Internet: www.wildeboer.de
www.wildeboer.eu

HAMBURG

WEENER / EMS

HANOVER

BERLIN

COLOGNE

FRANKFURT

STUTTGART

LEIPZIG

MUNICH



Leipzig office

Telephone: +49 (0)34444 - 310 - 0
Fax: +49 (0)4951 - 950 - 27298
E-mail: info@leipzig.wildeboer.de



Ulm office

Telephone: +49 (0)7392 - 9692 - 0
Fax: +49 (0)4951 - 950 - 27299
E-mail: info@ulm.wildeboer.de

TAKE ADVANTAGE OF OUR STRENGTHS!

WILDEBOER®

COMPONENTS FOR VENTILATION + AIR CONDITIONING

air distribution fire protection noise protection

building control systems